

# Technical Information

## Deltapilot S FMB70

Hydrostatic level measurement



Pressure sensor with CONTITE™ measuring cell  
Condensate-proofed

### Applications

The device is used for the following measuring tasks:

- Level, volume or mass measurements in liquids
- Pressure measurement in liquids, gases and paste-like media in all areas of process engineering, process measurement technology, pharmaceuticals and the food industry

### Your benefits

- Very good reproducibility and long-term stability
- Maximum plant safety thanks to unique condensate-proofed CONTITE measuring cell
- High reference accuracy up to 0.075 %
- Used for process level and pressure monitoring up to SIL3, certified according to IEC 61508 by TÜV SÜD
- High level of safety during operation thanks to function monitoring from the measuring cell to the electronics
- Easy electronic replacement guaranteed with HistoROM®/M-DAT
- Uniform platform for differential pressure, hydrostatics and pressure (Deltabar S – Deltapilot S – Cerabar S)
- Practical user navigation for quick and easy commissioning
- Extensive diagnostic functions
- For use in drinking water

## Table of contents

<b>Document information</b> . . . . .	<b>4</b>	Total performance . . . . .	26
Document function . . . . .	4	Long-term stability . . . . .	26
Symbols used . . . . .	4	Total error . . . . .	26
Documentation . . . . .	5	Warm-up period . . . . .	26
Terms and abbreviations . . . . .	6	<b>Installation</b> . . . . .	<b>27</b>
Turn down calculation . . . . .	7	General installation instructions . . . . .	27
Registered trademarks . . . . .	7	Measuring arrangement . . . . .	27
<b>Function and system design</b> . . . . .	<b>8</b>	Orientation . . . . .	27
Device selection . . . . .	8	Wall and pipe mounting . . . . .	27
Measuring principle . . . . .	9	"Separate housing" version . . . . .	28
Product design . . . . .	10	Turning the housing . . . . .	29
Communication protocol . . . . .	11	PWIS-free applications . . . . .	29
<b>Input</b> . . . . .	<b>12</b>	Applications with hydrogen . . . . .	29
Measured variable . . . . .	12	<b>Environment</b> . . . . .	<b>30</b>
Measuring range . . . . .	12	Ambient temperature range . . . . .	30
<b>Output</b> . . . . .	<b>13</b>	Storage temperature range . . . . .	30
Output Signal . . . . .	13	Degree of protection . . . . .	30
Signal range . . . . .	13	Climate class . . . . .	30
Signal on alarm . . . . .	13	Electromagnetic compatibility . . . . .	30
Load . . . . .	13	Vibration resistance . . . . .	30
Dead time, time constant . . . . .	14	<b>Process</b> . . . . .	<b>31</b>
Dynamic behavior, current output . . . . .	14	Process temperature limits . . . . .	31
Dynamic behavior Digital output (HART electronics) . . . . .	14	Pressure specifications . . . . .	31
Dynamic behavior PROFIBUS PA . . . . .	15	<b>Mechanical construction</b> . . . . .	<b>32</b>
Dynamic behavior FOUNDATION Fieldbus . . . . .	15	Device height . . . . .	32
Damping . . . . .	16	T14 housing, optional display on the side . . . . .	32
Alarm current . . . . .	16	T15 housing, optional display on the top . . . . .	33
Firmware version . . . . .	16	T17 housing (hygienic), optional display on the side . . . . .	33
HART protocol-specific data . . . . .	16	Process connections . . . . .	34
PROFIBUS PA protocol-specific data . . . . .	17	Process connections . . . . .	35
FOUNDATION Fieldbus protocol-specific data . . . . .	17	Hygienic connections . . . . .	38
<b>Power supply</b> . . . . .	<b>20</b>	Separate housing: Wall and pipe mounting with mounting bracket . . . . .	42
Terminal assignment . . . . .	20	Materials not in contact with process . . . . .	43
Supply voltage . . . . .	21	Weight . . . . .	45
Current consumption . . . . .	21	Materials in contact with process . . . . .	45
Electrical connection . . . . .	21	Fill fluid . . . . .	46
Terminals . . . . .	21	<b>Operability</b> . . . . .	<b>47</b>
Cable entries . . . . .	22	Operating concept . . . . .	47
Device plug . . . . .	22	Local operation . . . . .	47
Cable specification . . . . .	23	Remote operation . . . . .	50
Start-up current . . . . .	23	HistoROM®/M-DAT (optional) . . . . .	51
Residual ripple . . . . .	23	System integration . . . . .	52
Overvoltage protection (optionally for HART, PROFIBUS PA and FOUNDATION Fieldbus) . . . . .	23	<b>Certificates and approvals</b> . . . . .	<b>53</b>
Influence of power supply . . . . .	24	CE mark . . . . .	53
<b>Performance characteristics of the metallic process isolating diaphragm</b> . . . . .	<b>25</b>	RCM-Tick marking . . . . .	53
Reference operating conditions . . . . .	25	Ex approvals . . . . .	53
Influence of the installation position . . . . .	25	EAC conformity . . . . .	53
Resolution . . . . .	25	Suitable for hygiene applications . . . . .	53
Reference accuracy . . . . .	25	Functional safety SIL/ IEC 61508 Declaration of Conformity (optional) . . . . .	54
Thermal change of the zero output and the output span . . . . .	25		





Overfill protection . . . . .	54
CRN approval . . . . .	54
Other standards and guidelines . . . . .	54
Pressure Equipment Directive 2014/68/EU (PED) . . . . .	54
Manufacturer declarations . . . . .	55
Marine approval . . . . .	55
Drinking water approval . . . . .	55
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ISA 12.27.01 . . . . .	56
Inspection certificate . . . . .	56
Calibration . . . . .	56
Service . . . . .	57
Certificate of Compliance ASME BPE 2012 . . . . .	57
<b>Ordering information . . . . .</b>	<b>58</b>
Scope of delivery . . . . .	58
Measuring point (TAG) . . . . .	58
Configuration data sheet . . . . .	59
<b>Accessories . . . . .</b>	<b>61</b>
HistoROM®/M-DAT . . . . .	61
Welding flanges and welding neck . . . . .	61
Adapter Uni . . . . .	61
Additional mechanical accessories . . . . .	61
<b>Supplementary documentation . . . . .</b>	<b>62</b>
Field of Activities . . . . .	62
Technical Information . . . . .	62
Special Documentation . . . . .	62
Operating Instructions . . . . .	62
Brief Operating Instructions . . . . .	62
Functional safety manual (SIL) . . . . .	62
Overfill protection . . . . .	62
Safety Instructions (XA) . . . . .	62
Installation/Control Drawings . . . . .	63

## Document information



<b>Document function</b>	The document contains all the technical data on the device and provides an overview of the accessories and other products that can be ordered for the device.
--------------------------	---

### Symbols used









#### Safety symbols

Symbol	Meaning
	<b>DANGER!</b> This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury.
	<b>WARNING!</b> This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury.
	<b>CAUTION!</b> This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or medium injury.
	<b>NOTE!</b> This symbol contains information on procedures and other facts which do not result in personal injury.

#### Electrical symbols

Symbol	Meaning	Symbol	Meaning
	<b>Protective ground connection</b> A terminal which must be connected to ground prior to establishing any other connections.		<b>Ground connection</b> A grounded terminal which, as far as the operator is concerned, is grounded via a grounding system.

#### Symbols for certain types of information


Symbol	Meaning
	<b>Permitted</b> Procedures, processes or actions that are permitted.
	<b>Preferred</b> Procedures, processes or actions that are preferred.
	<b>Forbidden</b> Procedures, processes or actions that are forbidden.
	<b>Tip</b> Indicates additional information.
	Reference to documentation
	Reference to page
	Reference to graphic
	Visual inspection

### Symbols in graphics

Symbol	Meaning
1, 2, 3 ...	Item numbers
1., 2., 3. ...	Series of steps
A, B, C, ...	Views
A-A, B-B, C-C, ...	Sections

---

### Documentation


See chapter "Additional documentation" →  62




The document types listed are available:

In the Download Area of the Endress+Hauser Internet site: [www.endress.com](http://www.endress.com) → Download

### Safety Instructions (XA)

See the "Safety instructions" section →  62


## Terms and abbreviations

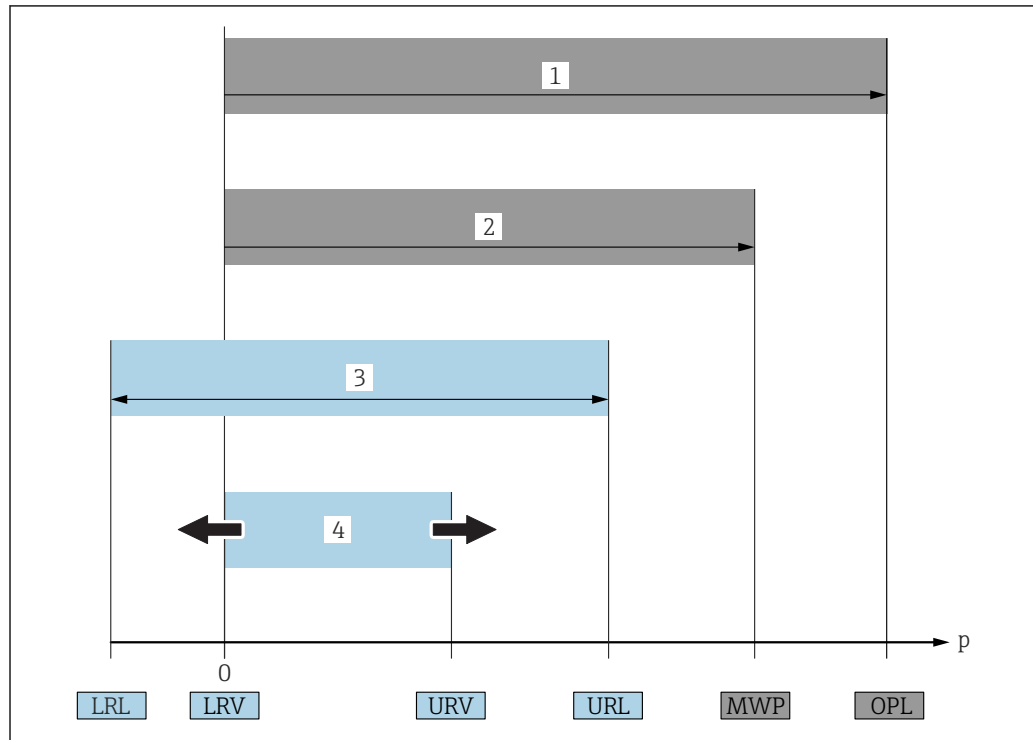

A0029505

Item	Term/abbreviation	Explanation
1	OPL	The OPL (over pressure limit = sensor overload limit) for the measuring device depends on the lowest-rated element, with regard to pressure, of the selected components, i.e. the process connection has to be taken into consideration in addition to the measuring cell. Also observe pressure-temperature dependency. For the relevant standards and additional information, see the "Pressure specifications" → 31 section. The OPL may only be applied for a limited period of time.
2	MWP	The MWP (maximum working pressure) for the sensors depends on the lowest-rated element, with regard to pressure, of the selected components, i.e. the process connection has to be taken into consideration in addition to the measuring cell. Also observe pressure-temperature dependency. For the relevant standards and additional information, see the "Pressure specifications" → 31 section. The MWP may be applied at the device for an unlimited period. The MWP can also be found on the nameplate.
3	Maximum sensor measuring range	Span between LRL and URL This sensor measuring range is equivalent to the maximum calibratable/adjustable span.
4	Calibrated/adjusted span	Span between LRV and URV Factory setting: 0 to URL Other calibrated spans can be ordered as customized spans.
p	-	Pressure
-	LRL	Lower range limit
-	URL	Upper range limit
-	LRV	Lower range value
-	URV	Upper range value
-	TD (turn down)	Turn down Example - see the following section.

**Turn down calculation**

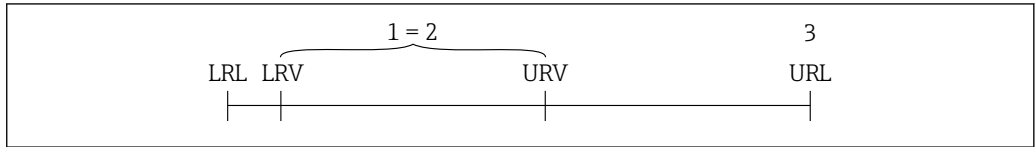

A0029545

- 1 *Calibrated/adjusted span*
- 2 *Zero point-based span*
- 3 *URL sensor*

**Example**

- Sensor: 10 bar (150 psi)
- Upper range value (URL) = 10 bar (150 psi)
- Calibrated/adjusted span: 0 to 5 bar (0 to 75 psi)
- Lower range value (LRV) = 0 bar (0 psi)
- Upper range value (URV) = 5 bar (75 psi)

Turn down (TD):

$$TD = \frac{URL}{|URV - LRV|}$$

$$TD = \frac{10 \text{ bar (150 psi)}}{|5 \text{ bar (75 psi)} - 0 \text{ bar (0 psi)}|} = 2$$

In this example, the TD is 2:1.  
This span is based on the zero point.

**Registered trademarks**

**HART®**

Registered trademark of the FieldComm Group, Austin, USA

**PROFIBUS®**


Registered trademark of the PROFIBUS User Organization, Karlsruhe, Germany

**FOUNDATION™Fieldbus**

Registered trademark of the FieldComm Group, Austin, Texas, USA

## Function and system design

### Device selection

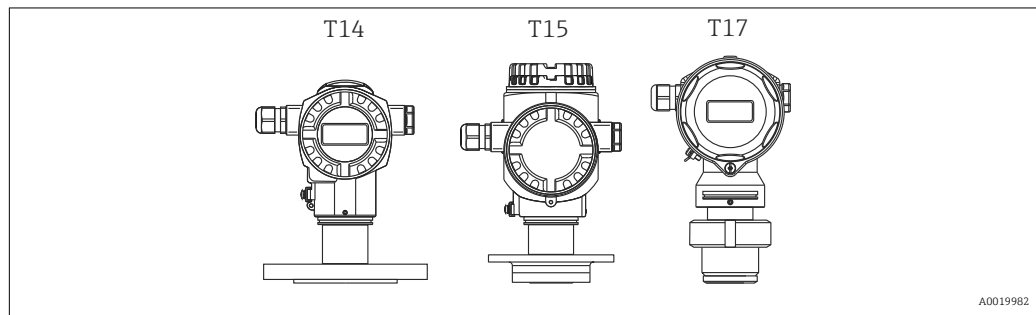

### Field of application

- Level measurement
- Pressure measurement

### Industries

Food, pharmaceutical, environment (fresh water and wastewater), chemical

### Process connections

- Thread
- Flanges
- Flush-mounted hygienic connections

### Process connection material

- AISI 316L (1.4435 or 1.4404) - see "Materials" section)
- Alloy C276 (2.4819)

### Measuring ranges

from -100 to +100 mbar (-1.5 to +1.5 psi)

to -1000 to +10000 mbar (-15 to +150 psi)

### OPL

max. 40 bar (600 psi)

### Process temperature range(temperature at process connection)

-10 to +100 °C (+14 to +212 °F); +135 °C (275 °F) for maximum 30 minutes

### Ambient temperature range

- Without LCD display: -40 to +85 °C (-40 to +185 °F) lower temperatures on request
- With LCD display: -20 to +70 °C (-4 to +158 °F)  
(extended temperature application range -40 to +85 °C (-40 to +185 °F) with limitations in optical properties, such as display speed and contrast)
- Separate housing: -20 to +60 °C (-4 to +140 °F)

### Reference accuracy

±0.1 % of the set span (0.075 % platinum)

### Supply voltage

Supply voltage non-Ex

- 4 to 20 mA HART: 10.5 to 45 V DC
- PROFIBUS PA and FOUNDATION Fieldbus: 9 to 32 V DC

Supply voltage Ex ia

10.5 to 30 V DC



**Output**


4 to 20 mA with superimposed HART protocol, PROFIBUS PA or FOUNDATION Fieldbus

**Options**

- Gold/rhodium-coated process isolating diaphragm
- Inspection certificate 3.1
- 3A and EHEDG approval
- HistoROM®/M-DAT memory chip
- Separate housing

**Specialties**

- Absolute resistance to condensate thanks to hermetically sealed CONTITE™ cell
- Maximum flexibility thanks to modular design
- Special cleaning of the transmitter to remove paint-wetting substances, for use in paint shops

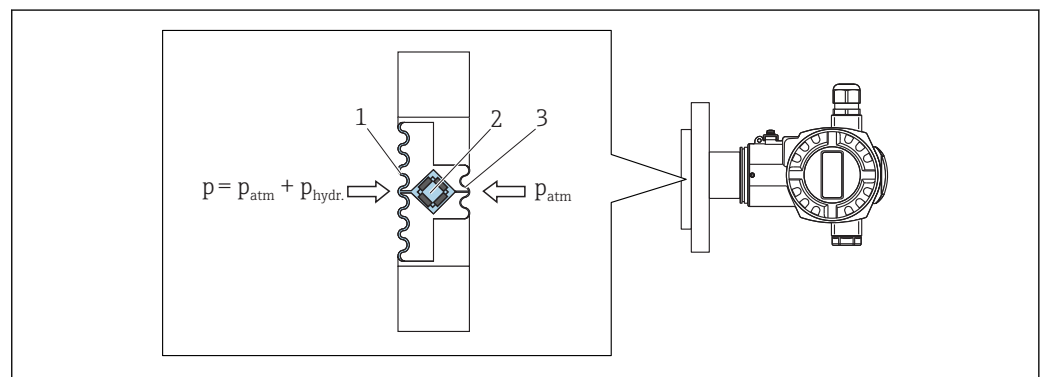
**Measuring principle****CONTITE™ measuring cell**

- 1 Process isolating diaphragm  
 2 Measuring element  
 3 Rear isolating membrane of the CONTITE™ measuring cell  
 $p_{atm}$  Atmospheric pressure  
 $p_{hydr}$  Hydrostatic pressure

Due to its weight, a liquid column creates hydrostatic pressure. If the density is constant, the hydrostatic pressure depends solely on the height  $h$  of the liquid column. The CONTITE™ measuring cell, which works according to the principle of the gauge pressure sensor, constitutes the core of the Deltapilot S. In contrast to conventional gauge pressure sensors, the precision measuring element (2) in the CONTITE™ measuring cell is absolutely protected between the process isolating diaphragm (1) and the rear isolating membrane (3).

**Advantages:**

- Thanks to this hermetic sealing of the measuring element, the CONTITE™ measuring cell is absolutely insensitive to condensate/condensation and aggressive gases. The pressure applied is transferred from the process isolating diaphragm to the measuring element by means of an oil without any loss in pressure.
- The sensor temperature is measured by means of the resistance bridge in the measuring cell. The electronics can compensate any measuring errors resulting from fluctuations in temperature with these measured temperature values.
- A linearization with max. 32 points, based on a table entered either manually or semi-automatically, can be activated locally or remotely. This function allows, for example, measurement in engineering units and provides a linear output signal for spherical and horizontal cylindrical tanks, and containers with a conical outlet.

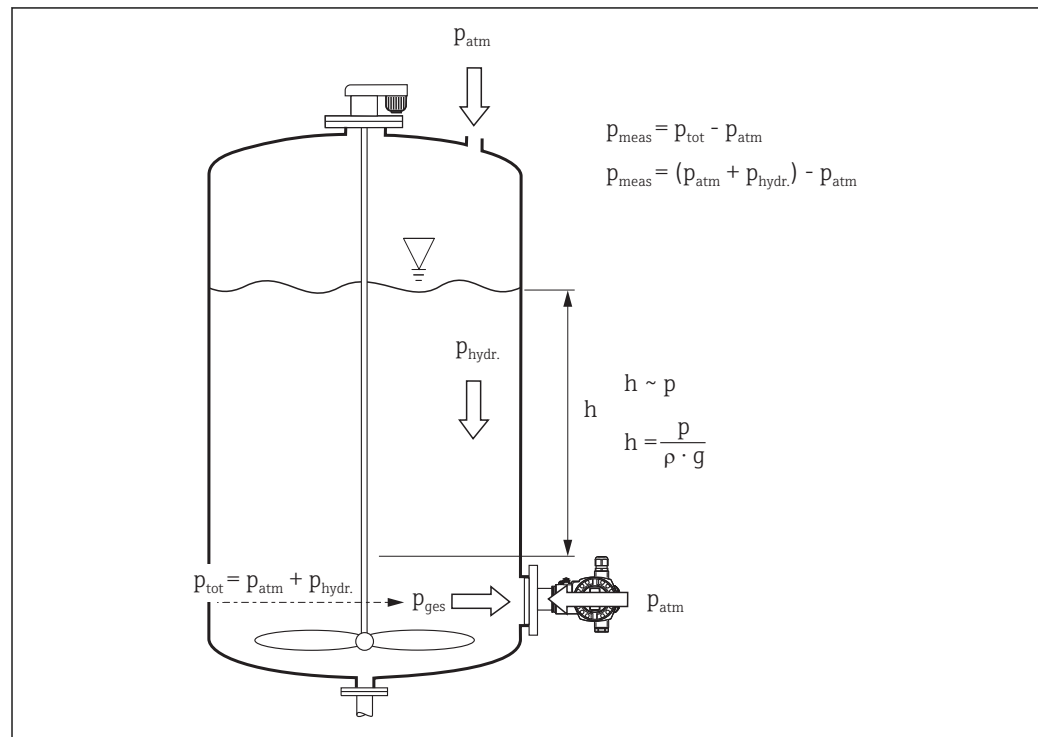


A0033934-EN

- $g$  Acceleration due to gravity  
 $h$  Height level  
 $p_{\text{tot}}$  Total pressure = hydrostatic pressure + atmospheric pressure  
 $p_{\text{atm}}$  Atmospheric pressure  
 $p_{\text{hydr.}}$  Hydrostatic pressure  
 $p_{\text{meas}}$  Measured pressure in the measuring cell = hydrostatic pressure  
 $\rho$  Density of the medium

#### Level measurement in closed tanks with pressure overlay

You can determine the differential pressure in tanks with pressure overlay using two Deltapilot S devices. The measured pressure values of the two Deltapilot S devices are sent to a signal processing unit such as Endress+Hauser RMA or a PLC. The signal processing unit or PLC determines the difference in pressure and uses this to calculate the level and the density where necessary.

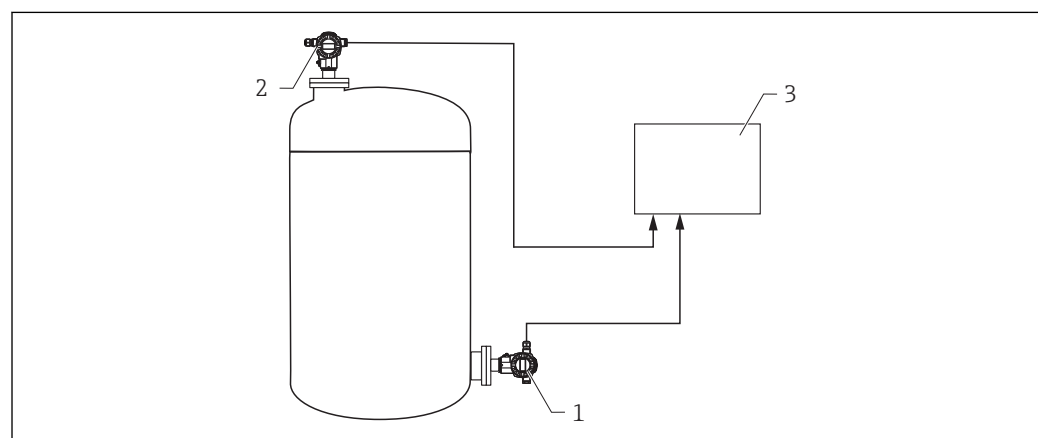

A0019984

- 1 Deltapilot 1 measures the total pressure (hydrostatic pressure and top pressure)  
 2 Deltapilot 2 measures the top pressure  
 3 The signal processing unit determines the difference in pressure and uses this, where necessary, to calculate the level

**NOTICE****Measured errors may occur**

If the ratio of level to top pressure is  $>1:6$ , measured errors may occur. Reproducibility is not affected.

- ▶ When selecting the Deltapilot S, make sure you choose sufficiently large measuring ranges (see the following example).
- ▶ Specific applications can be simulated with the Endress + Hauser Applicator (<https://portal.endress.com/webapp/applicator10>).

Example:

- Max. hydrostatic pressure = 600 mbar (9 psi)
- Max. top pressure (Deltapilot 2): 300 mbar (4.5 psi)
- Max. total pressure, measured with Deltapilot 1: 300 mbar (4.5 psi) + 600 mbar (9 psi) = 900 mbar (13.5 psi) measuring cell to be selected: 0 to 1200 mbar (0 to 18 psi)
- Max. pressure, measured with Deltapilot 2: 300 mbar (4.5 psi) → measuring cell to be selected: 0 to 400 mbar (0 to 6 psi)


**NOTICE****Possibility of probe 2 being flooded during differential pressure measurement**

Measured errors may occur.

- ▶ When installing, make sure probe 2 cannot be flooded.

*Density measurement*

You can measure the density in tanks with pressure overlay using two Deltapilot S devices and a signal processing unit or a PLC. The signal processing unit or the PLC calculates the density from the known distance  $\Delta h$  between the two Deltapilot S devices and the two measured values  $p_1$  and  $p_2$ .

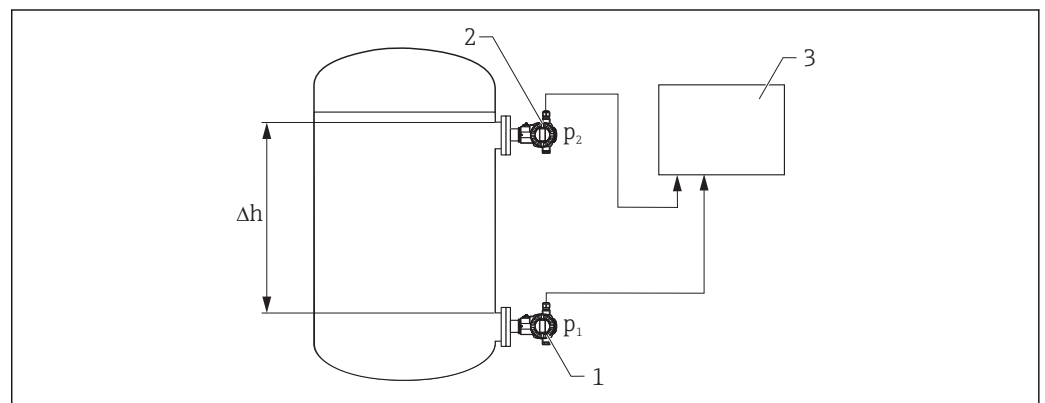

- 1 Deltapilot 1 determines pressure measured value  $p_1$
- 2 Deltapilot 2 determines pressure measured value  $p_2$
- 3 The signal processing unit determines the density from the two measured values  $p_1$  and  $p_2$  and the distance  $\Delta h$

**Communication protocol**

- 4 to 20 mA with HART communication protocol
- PROFIBUS PA
  - The Endress+Hauser devices meet the requirements of the FISCO model.
  - Due to a low current consumption of  $13 \text{ mA} \pm 1 \text{ mA}$ , the following number of devices can be operated on one bus segment if installing as per FISCO: up to 7 devices for Ex ia, CSA IS and FM IS applications or up to 27 devices for all other applications e.g. in non-hazardous areas, Ex nA etc. Further information on PROFIBUS PA can be found in Operating Instructions BA00034S "PROFIBUS DP/PA: Guidelines for planning and commissioning" and in the PNO Guideline.
- FOUNDATION Fieldbus
  - The Endress+Hauser devices meet the requirements of the FISCO model.
  - Due to a low current consumption of  $15.5 \text{ mA} \pm 1 \text{ mA}$ , the following number of devices can be operated on one bus segment if installing as per FISCO: up to 6 devices for Ex ia, CSA IS and FM IS applications or up to 24 devices for all other applications e.g. in non-hazardous areas, Ex nA etc. Further information on FOUNDATION Fieldbus, such as requirements for bus system components, can be found in Operating Instructions BA00013S "FOUNDATION Fieldbus Overview".

## Input

### Measured variable

### Measured process variables

Pressure

### Calculated process variables

Level (level, volume or mass)

### Measuring range

Sensor	Maximum sensor measuring range		Lowest calibratable span	MWP	OPL	Vacuum resistance <sup>1)</sup>	Option <sup>2)</sup>
	lower (LRL)	upper (URL)				Synthetic oil/ Inert oil	
	[bar (psi)]	[bar (psi)]				[bar <sub>abs</sub> (psi <sub>abs</sub> )]	
100 mbar (1.5 psi)	-0.1 (-1.5)	+0.1 (+1.5)	0.025 (0.375)	2.7 (40.5)	4 (60)	0.01/0.04 (0.15/0.6)	1C
400 mbar (6 psi)	-0.4 (-6)	+0.4 (+6)	0.04 (0.6)	5.3 (79.5)	8 (120)		1F
1.2 bar (18 psi)	-1.0 (-15)	+1.2 (+18)	0.1 (1.5)	16 (240)	24 (360)		1H
4 bar (60 psi)	-1.0 (-15)	+4 (+60)	0.1 (1.5)	16 (240)	24 (360)		1M
10 bar (150 psi)	-1.0 (-15)	+10 (+150)	0.1 (1.5)	27 (405)	40 (600)		1P


1) The vacuum resistance applies for the measuring cell under reference operating conditions.

2) Product Configurator, order code for "Sensor range; sensor over pressure limit"

## Output

### Output Signal

- 4 to 20 mA with superimposed digital communication protocol HART, 2-wire
- Digital communication signal PROFIBUS PA (Profile 3.0), 2-wire
  - Signal coding: Manchester Bus Powered (MBP): Manchester II
  - Transmission rate: 31.25 KBit/s voltage mode
- Digital communication signal FOUNDATION Fieldbus, 2-wire
  - Signal coding: Manchester Bus Powered (MBP): Manchester II
  - Transmission rate: 31.25 KBit/s voltage mode

Output	Internal + LCD	External + LCD	Internal
			<small>A0021280</small>
	Option <sup>1)</sup>		
4 to 20mA HART	B	A	C
4 to 20mA HART, Li=0	E	D	F
PROFIBUS PA	N	M	O
FOUNDATION Fieldbus	Q	P	R

1) Product Configurator, order code for "Display, operation: "

### Signal range

**4 to 20 mA**  
3.8 mA to 20.5 mA

### Signal on alarm

**4 to 20 mA HART**

As per NAMUR NE43.

- Max. alarm: can be set from 21 to 23 mA (factory setting: 22 mA)
- Hold measured value: last measured value is held
- Min. alarm: 3.6 mA

#### PROFIBUS PA

As per NAMUR NE43.

Can be set in the Analog Input Block.

Options:

- Last Valid Out Value (factory setting)
- Fail Safe Value
- Status bad

#### FOUNDATION Fieldbus

As per NAMUR NE43.

Can be set in the Analog Input Block.


Options:

- Last Good Value
- Fail Safe Value (factory setting)
- Wrong Value

### Load

**4 to 20 mA HART**

In order to guarantee sufficient terminal voltage in two-wire devices, a maximum load resistance R (including line resistance) must not be exceeded depending on the supply voltage  $U_0$  of the supply unit. In the following load diagrams, observe the position of the jumper and the explosion protection:

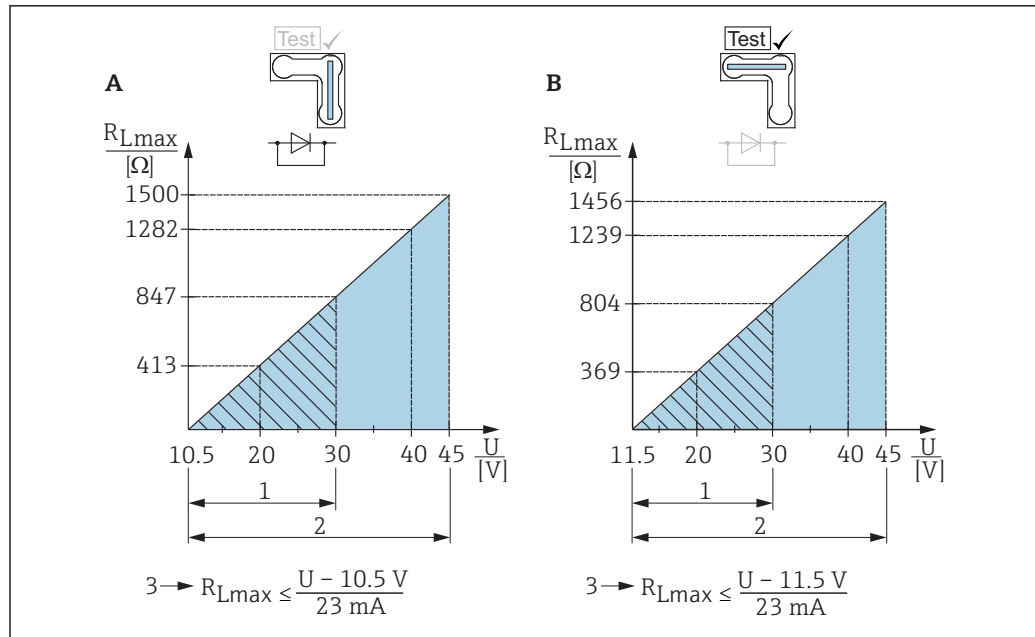


A0019988

- A Jumper for 4 to 20 mA test signal set to "Non-test" position
- B Jumper for 4 to 20 mA test signal set to "Test" position
- 1 Power supply 10.5 (11.5) to 30 V DC for 1/2 G, 1 GD, 1/2 GD, FM IS, CSA IS, NEPSI Ex ia and IEC Ex ia
- 2 Power supply 10.5 (11.5) to 45 V DC for devices for non-hazardous areas, 1/2 D, 1/3 D, 3 G Ex nA, FM DIP, FM NI and CSA dust ignition-proof
- 3  $R_{Lmax}$  maximum load resistance
- U Supply voltage

When operating via a handheld terminal or via a PC with an operating program, a minimum communication resistance of 250 Ω must be taken into account.

**Dead time, time constant**

Presentation of the dead time and the time constant:

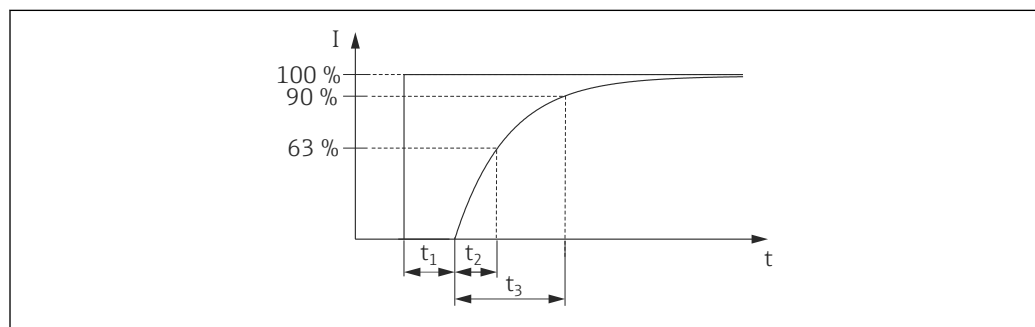

A0019786

**Dynamic behavior, current output**

	Dead time ( $t_1$ ) [ms]	Time constant T63 ( $t_2$ ) [ms]	Time constant T90 ( $t_3$ ) [ms]
max.	40	30	69

**Dynamic behavior Digital output (HART electronics)**

A typical burst rate of 300 ms results in the following behavior:

	Dead time ( $t_1$ ) [ms]	Dead time ( $t_1$ ) [ms] + Time constant T63 ( $t_2$ ) [ms]	Dead time ( $t_1$ ) [ms] + Time constant T90 ( $t_3$ ) [ms]
remains stable for a minimum of	200	230	230
max.	1000	1030	1030

**Reading cycle**

- Acyclic: max. 3/s, typically 1/s (depending on command # and number of preambles)
- Cyclic (burst): max. 3/s, typically 2/s

The device commands the BURST MODE functionality for cyclical value transmission via the HART communication protocol.

**Cycle time (update time)**

Cyclic (burst): min. 300 ms

**Response time**

- Acyclic: min. 330 ms, typically 590 ms (depending on command # and number of preambles)
- Cyclic (burst): min. 160 ms, typically 350 ms (depending on command # and number of preambles)

**Dynamic behavior  
PROFIBUS PA**

A typical PLC cycle time of 1 s results in the following behavior:

	Dead time (t <sub>1</sub> ) [ms]	Dead time (t <sub>1</sub> ) [ms] + Time constant T63 (t <sub>2</sub> ) [ms]	Dead time (t <sub>1</sub> ) [ms] + Time constant T90 (t <sub>3</sub> ) [ms]
remains stable for a minimum of	75	105	105
max.	1275	1305	1305

**Reading cycle (PLC)**

- Acyclic: Typically 25/s
- Cyclic: Typically 30/s (depending on the number and type of the function blocks used in the closed-control loop)

**Cycle time (update time)**

remains stable for a minimum of 200 ms

The cycle time in a bus segment in cyclic data communication depends on the number of devices, on the segment coupler used and on the internal PLC cycle time. A new measured value can be determined up to five times a second.

**Response time**

- Acyclic: Approx. 60 ms to 70 ms (depending on Min. Slave Interval)
- Cyclic: Approx. 10 ms to 13 ms (depending on Min. Slave Interval)

**Dynamic behavior  
FOUNDATION Fieldbus**

A typical configuration for the macro cycle time (host system) of 1 s results in the following behavior:

	Dead time (t <sub>1</sub> ) [ms]	Dead time (t <sub>1</sub> ) [ms] + Time constant T63 (t <sub>2</sub> ) [ms]	Dead time (t <sub>1</sub> ) [ms] + Time constant T90 (t <sub>3</sub> ) [ms]
remains stable for a minimum of	85	115	115
max.	1085	1115	1115

**Reading cycle**

- Acyclic: Typically 10/s
- Cyclic: max. 10/s (dependent on the number and type of function blocks used in a closed-control loop)

**Cycle time (update time)**

Cyclic: Min. 100 ms

**Response time**

- Acyclic: Typically 100 ms (for standard bus parameter settings)
- Cyclic: max. 20 ms (for standard bus parameter settings)

**Damping**

A damping affects all outputs (output signal, display):

- via local display, handheld terminal or PC with operating program, continuous from 0 to 999 s
- Also for HART and PROFIBUS PA: Via DIP switch on the electronic insert, switch position "on" = set value and "off"
- Factory setting: 2 s

**Alarm current**

Description	Option <sup>1)</sup>
Min alarm current	J
HART burst mode PV	J
Min alarm current + HART burst mode PV	J

1) Product Configurator, "Additional options 1" and "Additional options 2" ordering feature

**Firmware version**

Description	Option <sup>1)</sup>
02.20.zz, HART 7, DevRev22	72
02.11.zz, HART 5, DevRev21	73
04.00.zz, FF, DevRev07	74
04.01.zz, PROFIBUS PA, DevRev03	75
02.10.zz, HART 5, DevRev21	76
03.00.zz, FF, DevRev06	77
04.00.zz, PROFIBUS PA	78
02.30.zz, HART 7	71

1) Product Configurator, order code for "Firmware version"

**HART protocol-specific data**

Manufacturer ID	17 (11 hex)
Device type code	26 (1A hex)
Device revision	<ul style="list-style-type: none"> <li>▪ 21 (15 hex) - SW version 02.1y.zz - HART specification 5</li> <li>▪ 22 (16 hex) - SW version 02.2y.zz - HART specification 7</li> </ul>
HART specification	<ul style="list-style-type: none"> <li>▪ 5</li> <li>▪ 7</li> </ul>
DD revision	<ul style="list-style-type: none"> <li>▪ 4 (Russian in language selection) for device revision 21</li> <li>▪ 3 (Dutch in language selection) for device revision 21</li> <li>▪ 1 for device revision 22</li> </ul>
Device description files (DTM, DD)	Information and files at: <ul style="list-style-type: none"> <li>▪ <a href="http://www.endress.com">www.endress.com</a></li> <li>▪ <a href="http://www.fieldcommgroup.org">www.fieldcommgroup.org</a></li> </ul>
HART load	Min. 250 Ω



HART device variables	<p>The measured values are assigned to the device variables as follows:</p> <p><b>Measured values for PV (primary variable)</b></p> <ul style="list-style-type: none"> <li>▪ Pressure</li> <li>▪ Level</li> <li>▪ Tank content</li> </ul> <p><b>Measured values for SV, TV (second and third variable)</b></p> <p>Pressure</p> <p><b>Measured values for QV (fourth variable)</b></p> <p>Temperature</p>
Supported functions	<ul style="list-style-type: none"> <li>▪ Burst mode</li> <li>▪ Additional transmitter status</li> <li>▪ Device locking</li> <li>▪ Alternative operating modes</li> </ul>

**PROFIBUS PA protocol-specific data**

Manufacturer ID	17 (11 hex)
Identification number	154F hex
Profile version	<p>3.0</p> <ul style="list-style-type: none"> <li>▪ SW version 03.00.zz</li> <li>▪ SW version 04.00.zz</li> </ul> <p>3.02</p> <p>SW version 04.01.zz ( device revision 3)</p> <p>Compatibility with SW version 03.00.zz and higher.</p>
GSD revision	<ul style="list-style-type: none"> <li>▪ 4 (SW version 3.00.zz and 4.00.zz)</li> <li>▪ 5 (device revision 3)</li> </ul>
DD revision	<ul style="list-style-type: none"> <li>▪ 1 (SW version 3.00.zz and 4.00.zz)</li> <li>▪ 1 (device revision 3)</li> </ul>
GSD file	Information and files at:
DD files	<ul style="list-style-type: none"> <li>▪ <a href="http://www.endress.com">www.endress.com</a></li> <li>▪ <a href="http://www.profibus.org">www.profibus.org</a></li> </ul>
Output values	<p><b>Measured value for PV (via Analog Input Function Block)</b></p> <ul style="list-style-type: none"> <li>▪ Pressure</li> <li>▪ Level</li> <li>▪ Tank content</li> </ul> <p><b>Measured value for SV</b></p> <ul style="list-style-type: none"> <li>▪ Pressure</li> <li>▪ Temperature</li> </ul>
Input values	Input value sent from PLC, can be shown on display
Supported functions	<ul style="list-style-type: none"> <li>▪ Identification &amp; maintenance Simplest device identifier on the control system and nameplate</li> <li>▪ Condensed status (only with Profile Version 3.02)</li> <li>▪ Automatic ID number adjustment and switchable to the following ID numbers (only with Profile Version 3.02): <ul style="list-style-type: none"> <li>- 9700: Profile-specific transmitter identification number with the "Classic" or "Condensed" status".</li> <li>- 1503: Compatibility mode for the old Deltapilot S generation (DB50, DB50L, DB51, DB52, DB53).</li> <li>- 154F: Identification number for the new Deltapilot S generation (FMB70).</li> </ul> </li> <li>▪ Device locking: The device can be locked by hardware or software.</li> </ul>

**FOUNDATION Fieldbus protocol-specific data**

Manufacturer ID	452B48 hex
Device type	100B hex
Device revision	<ul style="list-style-type: none"> <li>▪ 6 - SW version 03.00.zz</li> <li>▪ 7 - SW version 04.00.zz (FF-912)</li> </ul>
DD revision	<ul style="list-style-type: none"> <li>▪ 3 (device revision 6)</li> <li>▪ 2 (device revision 7)</li> </ul>
CFR revision	<ul style="list-style-type: none"> <li>▪ 4 (device revision 6)</li> <li>▪ 1 (device revision 7)</li> </ul>

DD files	Information and files at:
CFF files	
Device tester version (ITK version)	<ul style="list-style-type: none"> <li>▪ <a href="http://www.endress.com">www.endress.com</a></li> <li>▪ <a href="http://www.fieldcommgroup.org">www.fieldcommgroup.org</a></li> </ul>
Number of ITK test campaign	<ul style="list-style-type: none"> <li>▪ 5.0 (device revision 6)</li> <li>▪ 6.01 (device revision 7)</li> </ul>
Link Master (LAS) capable	Yes
Choice of "Link Master" and "Basic Device"	Yes, factory setting is Basic Device
Node address	Factory setting: 247 (F7 hex)
Supported functions	Field diagnostics profile (only with FF912) The following methods are supported: <ul style="list-style-type: none"> <li>▪ Restart</li> <li>▪ Configure error as warning or alarm</li> <li>▪ HistROM</li> <li>▪ Peakhold</li> <li>▪ Alarm info</li> <li>▪ Sensor trim</li> </ul>
Number of VCRs	<ul style="list-style-type: none"> <li>▪ 44 (device revision 6)</li> <li>▪ 24 (device revision 7)</li> </ul>
Number of link objects in VFD	50

#### Virtual communication references (VCRs)

	Device revision 6	Device revision 7
Permanent entries	44	1
Client VCRs	0	0
Server VCRs	5	10
Source VCRs	8	43
Sink VCRs	0	0
Subscriber VCRs	12	43
Publisher VCRs	19	43

#### Link settings

	Device revision 6	Device revision 7
Slot time	4	4
Min. Inter PDU delay	12	10
Max. response delay	10	10

#### Transducer Blocks

Block	Content	Output values
TRD1 Block	Contains all parameters related to the measurement	Process temperature (channel 2)
Service Block	Contains service information	<ul style="list-style-type: none"> <li>▪ Pressure after damping (channel 3)</li> <li>▪ Pressure peakhold indicator (channel 4)</li> <li>▪ Counter for max. pressure transgressions (channel 5)</li> </ul>

Block	Content	Output values
Diagnostic Block	Contains diagnostic information	Error code via DI channels (channel 0 to 16)
Display Block	Contains parameters to configure the onsite display	No output values

**Function blocks**

Block	Content	Number blocks	Execution time		Functionality	
			Device Revision 6	Device Revision 7	Device Revision 6	Device Revision 7
Resource Block	This block contains all the data that uniquely identifies the device; it is an electronic version of a nameplate for the device.	1			enhanced	enhanced
Analog Input Block 1 Analog Input Block 2	The AI Block receives the measuring data from the Sensor Block, (selectable via a channel number) and makes the data available to other function blocks at its output. Enhancement: Digital outputs for process alarms, fail safe mode	2	45 ms	45 ms (without trend and alarm reports)	enhanced	enhanced
Digital Input Block	This block contains the discrete data of the Diagnose Block (selectable via a channel number 0 to 16) and provides them for other blocks at the output.	1	40 ms	30 ms	standard	enhanced
Digital Output Block	This block converts the discrete input and thus initiates an action (selectable via a channel number) in the DP Flow Block or in the Service Block. Channel 1 resets the counter for max. pressure transgressions.	1	60 ms	40 ms	standard	enhanced
PID Block	This block is used as a proportional-integral-derivative controller and can be used universally for closed-loop-control in the field. It enables cascade mode and feedforward control. Input IN can be indicated on the display. The selection is performed in the Display Block (DISPLAY_MAIN_LINE_CONTENT).	1	120 ms	70 ms	standard	enhanced
Arithmetic Block	This block is designed to permit simple use of popular measurement math functions. The user does not have to know how to write equations. The math algorithm is selected by name, chosen by the user for the function to be performed.	1	50 ms	40 ms	standard	enhanced
Input Selector Block	The Input Selector Block facilitates the selection of up to four inputs and generates an output based on the configured action. This block normally receives its inputs from AI Blocks. The block performs maximum, minimum, average and 'first good' signal selection. Inputs IN1 to IN4 can be indicated on the display. The selection is performed in the Display Block (DISPLAY_MAIN_LINE_CONTENT).	1	35 ms	35 ms	standard	enhanced
Signal Characterizer Block	The Signal Characterizer Block has two sections, each with an output that is a non-linear function of the respective input. The non-linear function is generated by a single look-up table with 21 arbitrary x-y pairs.	1	30 ms	40 ms	standard	enhanced
Integrator Block	The Integrator Block integrates a variable as a function of the time or accumulates the counts from a Pulse Input Block. The block can be used as a totalizer that counts up until a reset, or as a batch totalizer whereby the integrated value is compared against a target value generated before or during the control routine and generates a binary signal when the target value is reached.	1	35 ms	40 ms	standard	enhanced
Analog Alarm Block	This block contains all process alarm conditions (working like a comparator) and represents them at the output.	1	35 ms	35 ms	standard	enhanced

*Additional function block information:*

Instantiatable function blocks	YES	YES
Number of additional instantiatable function blocks	11	5

## Power supply


### **⚠ WARNING**

#### Electrical safety is compromised by an incorrect connection!

- ▶ When using the measuring device in hazardous areas, the relevant national standards and regulations as well as the Safety Instructions or Installation or Control Drawings must also be observed. → 62.
- ▶ All explosion protection data are given in separate documentation which is available upon request. The Ex documentation is supplied as standard with all Ex devices → 62.
- ▶ Devices with integrated overvoltage protection must be grounded → 23.
- ▶ Protective circuits against reverse polarity, HF influences and overvoltage peaks are integrated.

### Terminal assignment


#### 4 to 20 mA HART

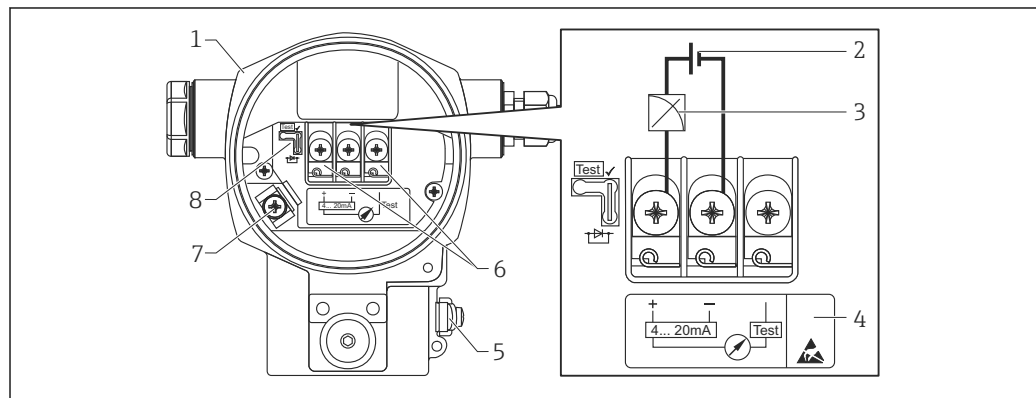

A0019989

- 1 Housing
- 2 Supply voltage
- 3 4 to 20 mA
- 4 Devices with integrated overvoltage protection are labeled "OVP" (overvoltage protection) here.
- 5 External ground terminal
- 6 4 to 20 mA test signal between positive and test terminal
- 7 Internal ground terminal
- 8 Jumper for 4 to 20 mA test signal

#### PROFIBUS PA and FOUNDATION Fieldbus

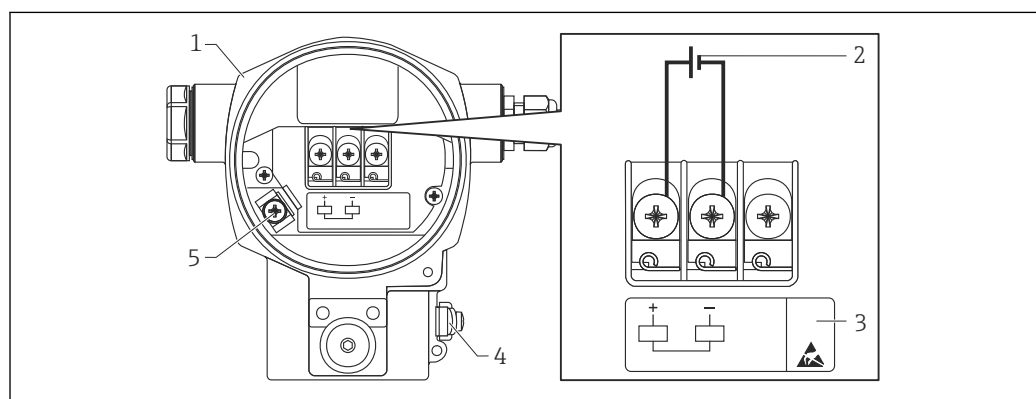

A0020158



- 1 Housing
- 2 Supply voltage
- 3 Devices with integrated overvoltage protection are labeled "OVP" (overvoltage protection) here.
- 4 External ground terminal
- 5 Internal ground terminal

**Supply voltage**

**4 to 20 mA HART**

Electronic version	Jumper for 4 to 20 mA test signal in "Test" position (delivery status)	Jumper for 4 to 20 mA test signal in "Non-test" position
Version for non-hazardous area	11.5 to 45 V DC	10.5 to 45 V DC
Intrinsically safe	11.5 to 30 V DC	10.5 to 30 V DC
<ul style="list-style-type: none"> <li>▪ Other types of protection</li> <li>▪ Devices without certificate</li> </ul>	11.5 to 45 V DC (versions with 35 V DC plug-in connection)	10.5 to 45 V DC (versions with 35 V DC plug-in connection)

*Measuring a 4 to 20 mA test signal*

Jumper position for test signal	Description
	<ul style="list-style-type: none"> <li>▪ Measurement of 4 to 20 mA test signal via the positive and test terminal: Possible. (Thus, the output current can be measured without interruption via the diode.)</li> <li>▪ Delivery status</li> <li>▪ Minimum supply voltage: 11.5 V DC</li> </ul>
	<ul style="list-style-type: none"> <li>▪ Measurement of 4 to 20 mA test signal via positive and test terminal: Not possible.</li> <li>▪ Minimum supply voltage: 10.5 V DC</li> </ul>

**PROFIBUS PA**

- Version for non-hazardous areas: 9 to 32 V DC
- Ex ia: 10.5 to 30 V DC

**FOUNDATION Fieldbus**

- Version for non-hazardous areas: 9 to 32 V DC
- Ex ia: 10.5 to 30 V DC

**Current consumption**

- PROFIBUS PA: 13 mA ±1 mA, switch-on current corresponds to IEC 61158-2, Clause 2.1
- FOUNDATION Fieldbus: 15.5 mA ±1 mA, switch-on current corresponds to IEC 61158-2, Clause 2.1

**Electrical connection**

**PROFIBUS PA**

The digital communication signal is transmitted to the bus via a two-wire connection. The bus also provides the power supply. For further information on the network structure and grounding, and for further bus system components such as bus cables, see the relevant documentation, e.g. Operating Instructions BA00034S "PROFIBUS DP/PA: Guidelines for planning and commissioning" and the PNO Guideline.

**FOUNDATION Fieldbus**

The digital communication signal is transmitted to the bus via a two-wire connection. The bus also provides the power supply. For further information on the network structure and grounding and for further bus system components such as bus cables, see the relevant documentation, e.g. Operating Instructions BA00013S "FOUNDATION Fieldbus Overview" and the FOUNDATION Fieldbus Guideline.

**Terminals**

- Supply voltage and internal ground terminal: 0.5 to 2.5 mm<sup>2</sup> (20 to 14 AWG)
- External ground terminal: 0.5 to 4 mm<sup>2</sup> (20 to 12 AWG)


**Cable entries**

Approval	Cable gland	Clamping area
Standard, II 1/2 G Ex ia, IS	Plastic M20x1.5	5 to 10 mm (0.2 to 0.39 in)
ATEX II 1/2 D, II 1/3 D, II 1/2 GD Ex ia, II 1 GD Ex ia, II 3 G Ex nA	Metal M20x1.5 (Ex e)	7 to 10.5 mm (0.28 to 0.41 in)

For additional technical data, see section on housing → 32

**Device plug**


**Devices with Harting plug Han7D**

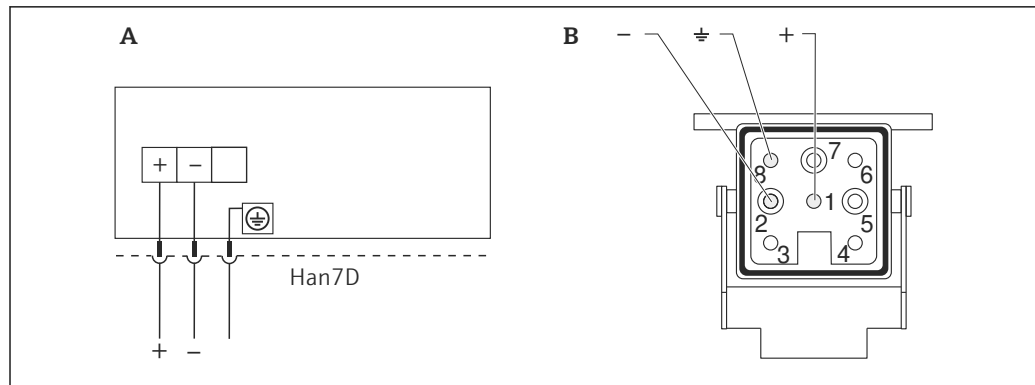

A Electrical connection for devices with Harting plug Han7D  
 B View of the plug-in connection on the device


Material: CuZn, gold-plated plug-in jack and plug

**Cable version connection**

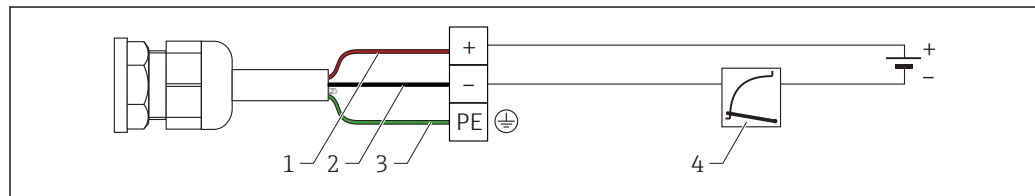

- 1 rd = red
- 2 bk = black
- 3 gnye = green
- 4 4 to 20 mA

**Devices with M12 plug**

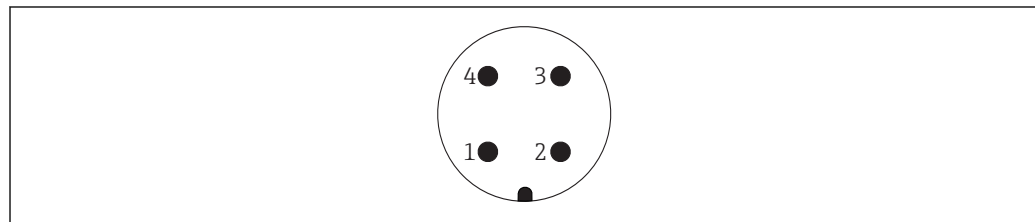

- 1 Signal +
- 2 Not assigned
- 3 Signal -
- 4 Ground

Endress+Hauser offers the following accessories for devices with an M12 plug:

Plug-in jack M 12x1, straight

- Material: Body PA; coupling nut CuZn, nickel-plated
- Degree of protection (fully locked): IP67
- Order number: 52006263


Plug-in jack M 12x1, elbowed

- Material: Body PBT/PA; coupling nut GD-Zn, nickel-plated
- Degree of protection (fully locked): IP67
- Order number: 71114212

Cable 4x0.34 mm<sup>2</sup> (20 AWG) with M12 socket, elbowed, screw plug, length 5 m (16 ft)

- Material: Body PUR; coupling nut CuSn/Ni; cable PVC
- Degree of protection (fully locked): IP67
- Order number: 52010285

**Devices with 7/8" plug**

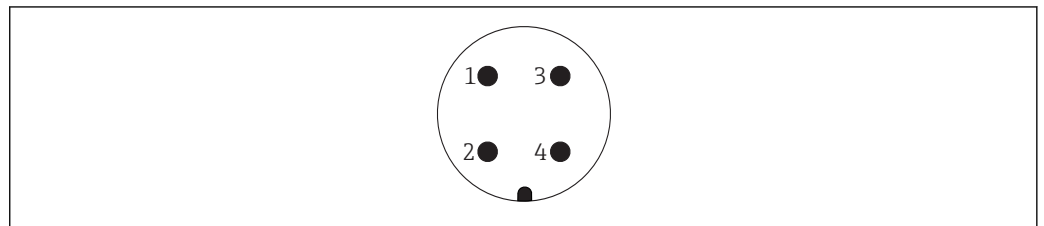

A0011176

- 1 Signal -
- 2 Signal +
- 3 Not assigned
- 4 Shielding

External thread: 7/8 - 16 UNC

- Material: 316L (1.4401)
- Degree of protection: IP68

**Cable specification**

**HART**

- Endress+Hauser recommends using shielded, twisted-pair two-wire cables.
- Cable outer diameter: 5 to 9 mm (0.2 to 0.35 in) depending on the cable entry used → 22

**PROFIBUS PA**

Use a twisted, shielded twin-core cable, preferably cable type A.

- For further information regarding cable specifications, see the Operating Instructions BA00034S "PROFIBUS DP/PA: Guidelines for planning and commissioning", the PNO guideline 2.092 "PROFIBUS PA User and Installation Guideline" and IEC 61158-2 (MBP).

**FOUNDATION Fieldbus**

Use a twisted, shielded twin-core cable, preferably cable type A.

- For further information on the cable specifications, see Operating Instructions BA00013S "FOUNDATION Fieldbus Overview", FOUNDATION Fieldbus Guideline and IEC 61158-2 (MBP).

**Start-up current**

12 mA

**Residual ripple**

Without influence on 4 to 20 mA signal up to ±5% residual ripple within the permitted voltage range [according to HART hardware specification HCF\_SPEC-54 (DIN IEC 60381-1)].

**Overvoltage protection (optionally for HART, PROFIBUS PA and FOUNDATION Fieldbus)**

- Overvoltage protection:
  - Nominal functioning DC voltage: 600 V
  - Nominal discharge current: 10 kA
- Surge current check  $\hat{i} = 20$  kA satisfied as per DIN EN 60079-14: 8/20  $\mu$ s
- Arrester AC current check  $I = 10$  A satisfied

Ordering information: Product Configurator, order code for "Additional options 1" or Additional options 2", option "M"

**NOTICE**

**Device could be destroyed!**

- ▶ Devices with integrated overvoltage protection must be grounded.


---

**Influence of power supply**      $\leq 0.0006$  % of URL/1 V



## Performance characteristics of the metallic process isolating diaphragm

### Reference operating conditions


- As per IEC 60770
- Ambient temperature  $T_U$  = constant, in range: +21 to +33 °C (+70 to +91 °F)
- Humidity  $\phi$  = constant, in range: 5 to 80 % rH
- Ambient pressure  $p_A$  = constant, in range: 860 to 1 060 mbar (12.47 to 15.37 psi)
- Position of measuring cell = constant, in range: horizontal  $\pm 1^\circ$  (see also "Influence of the installation position" section →  25)
- Input of LOW SENSOR TRIM and HIGH SENSOR TRIM for lower range value and upper range value
- Zero based span
- Process isolating diaphragm material: Alloy C276 (2.4819)
- Filling oil: synthetic oil / inert oil
- Supply voltage: 24 V DC  $\pm 3$  V DC
- Load with HART: 250  $\Omega$

### Influence of the installation position

Maximum:  $\pm 2.3$  mbar (0.0345 psi).

The value is doubled for devices with inert oil.



Position-dependent zero shift can be corrected →  27.

### Resolution

- Current output: 1  $\mu$ A
- Display: can be set (factory setting: presentation of the maximum accuracy of the transmitter)

### Reference accuracy

The reference accuracy contains the non-linearity [DIN EN 61298-2 3.11] including the pressure hysteresis [DIN EN 61298-23.13] and non-repeatability [DIN EN 61298-2 3.11] in accordance with the limit point method as per [DIN EN 60770]. The specifications refer to the calibrated span.

Measuring cell	% of the set span	
	Standard	Platinum
100 mbar (1.5 psi)	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 2:1 = <math>\pm 0.15</math></li> <li>■ TD &gt; 2:1 to TD 4:1 = <math>\pm 0.075 \times \text{TD}</math></li> </ul>	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 2:1 = <math>\pm 0.1</math></li> <li>■ TD &gt; 2:1 to TD 4:1 = <math>\pm 0.05 \times \text{TD}</math></li> </ul>
400 mbar (6 psi)	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 4:1 = <math>\pm 0.15</math></li> <li>■ TD &gt; 4:1 to TD 10:1 = <math>\pm 0.0375 \times \text{TD}</math></li> </ul>	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 4:1 = <math>\pm 0.1</math></li> <li>■ TD &gt; 4:1 to TD 10:1 = <math>\pm 0.025 \times \text{TD}</math></li> </ul>
1.2 bar (18 psi)	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 2:1 = <math>\pm 0.1</math></li> <li>■ TD &gt; 2:1 to TD 12:1 = <math>\pm 0.05 \times \text{TD}</math></li> </ul>	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 2:1 = <math>\pm 0.075</math></li> <li>■ TD &gt; 2:1 to TD 12:1 = <math>\pm 0.0375 \times \text{TD}</math></li> </ul>
4 bar (60 psi)	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 4:1 = <math>\pm 0.1</math></li> <li>■ TD &gt; 4:1 to TD 40:1 = <math>\pm 0.025 \times \text{TD}</math></li> </ul>	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 4:1 = <math>\pm 0.075</math></li> <li>■ TD &gt; 4:1 to TD 40:1 = <math>\pm 0.02 \times \text{TD}</math></li> </ul>
10 bar (150 psi)	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 2.5:1 = <math>\pm 0.1</math></li> <li>■ TD &gt; 2.5:1 to TD 40:1 = <math>\pm 0.04 \times \text{TD}</math></li> </ul>	<ul style="list-style-type: none"> <li>■ TD 1:1 to TD 2.5:1 = <math>\pm 0.075</math></li> <li>■ TD &gt; 2.5:1 to TD 40:1 = <math>\pm 0.03 \times \text{TD}</math></li> </ul>

### Thermal change of the zero output and the output span

Measuring cell	% of the set span			
	-10 to +60 °C (+14 to 140 °F)		+60 to +85 °C (+140 to 185 °F)	
	Standard	Platinum	Standard	Platinum
100 mbar (1.5 psi)	$\pm(0.3 \times \text{TD} + 0.02)$	$\pm(0.2 \times \text{TD} + 0.02)$	$\pm(0.4 \times \text{TD} + 0.04)$	$\pm(0.3 \times \text{TD} + 0.04)$
400 mbar (6 psi)	$\pm(0.25 \times \text{TD} + 0.01)$	$\pm(0.15 \times \text{TD} + 0.01)$	$\pm(0.3 \times \text{TD} + 0.02)$	$\pm(0.2 \times \text{TD} + 0.02)$
1.2 bar (18 psi), 4 bar (60 psi), 10 bar (150 psi)	$\pm(0.1 \times \text{TD} + 0.01)$	$\pm(0.075 \times \text{TD} + 0.01)$	$\pm(0.15 \times \text{TD} + 0.02)$	$\pm(0.1 \times \text{TD} + 0.02)$

These values specify the thermal change for the most unfavorable situation where the process temperature and the ambient temperature change independently of each other.

**Total performance**

The "Total performance" specification comprises the non-linearity including hysteresis and non-reproducibility as well as the thermal change of the zero point.

All specifications apply to the temperature range  $-10$  to  $+60$  °C ( $+14$  to  $+140$  °F) and a turndown of 1:1.

Measuring cell	% of URL	
	Standard	Platinum
100 mbar (1.5 psi), 400 mbar (6 psi)	$\pm 0.35$	$\pm 0.25$
1.2 bar (18 psi), 4 bar (60 psi), 10 bar (150 psi)	$\pm 0.15$	$\pm 0.12$

**Long-term stability**

Measuring cell	% of URL/1 year	% of URL/5 years
100 mbar (1.5 psi)	$\pm 0.18$	$\pm 0.45$
400 mbar (6 psi), 1.2 bar (18 psi)	$\pm 0.1$	$\pm 0.25$
4 bar (60 psi), 10 bar (150 psi)	$\pm 0.05$	$\pm 0.125$

**Total error**

The total error comprises the total performance and long-term stability.

All specifications apply to the temperature range  $-10$  to  $+60$  °C ( $+14$  to  $+140$  °F) and a turndown of 1:1.

Measuring cell	% of URL/year	
	Standard	Platinum
100 mbar (1.5 psi)	$\pm 0.53$	$\pm 0.43$
400 mbar (6 psi)	$\pm 0.45$	$\pm 0.35$
1.2 bar (18 psi)	$\pm 0.25$	$\pm 0.22$
4 bar (60 psi), 10 bar (150 psi)	$\pm 0.20$	$\pm 0.17$

**Warm-up period**

- 4 to 20 mA HART: < 10 s
- PROFIBUS PA: 6 s
- FOUNDATION Fieldbus: 50 s

## Installation

---

### General installation instructions

- A position-dependent zero point shift can be corrected directly at the device via operating keys, and also in hazardous areas in the case of devices with external operation.
- The device housing can be rotated up to 380° .
- When measuring in media containing solids, such as dirty liquids, installing separators and drain valves is useful for capturing and removing sediment.
- Point the cable and connector downwards where possible to prevent moisture from entering (e.g. rain or condensation water).

---

### Measuring arrangement

#### Level measurement

- Always install the device below the lowest measuring point.
- Do not install the device at the following positions:
  - In the filling curtain
  - In the tank outlet
  - Or at a point in the tank which could be affected by pressure pulses from the agitator.
- The calibration and functional test can be carried out more easily if you mount the device downstream from a shutoff device.
- The Deltapilot S must be included in the insulation for media than can harden when cold.

#### Pressure measurement in gases

Mount Deltapilot S with shutoff device above the tapping point so that any condensate can flow into the process.

#### Pressure measurement in vapors

Use siphons for pressure measurement in steam. The siphon reduces the temperature to almost ambient temperature. Fill the siphon with liquid before commissioning. Preferably mount the Deltapilot S with the siphon below the tapping point.

Advantages:

- defined water column only causes minimal/negligible measured errors
- only minimal/negligible thermal effects on the device


Mounting above the tapping point is also possible. Note the max. permitted ambient temperature of the transmitter!

#### Pressure measurement in liquids

Mount Deltapilot S with shutoff device below or at the same level as the tapping points.

---

### Orientation

The orientation may cause a zero point shift, see →  25.

This position-dependent zero point shift can be corrected directly at the device via the operating key, and also in hazardous areas in the case of devices with external operation (position adjustment).

---

### Wall and pipe mounting

Endress+Hauser offers a mounting bracket for installing the device on pipes or walls. The mounting bracket can be installed on pipes with a diameter of 1¼" to 2" or on walls.

Ordering information:

- Product Configurator, order code for "Additional options 2", version "U" or Product Configurator, order code for "Accessory enclosed", version "PA" or
- as a separate accessory (part no.: 71102216).

Dimensions .

**"Separate housing" version**

With the "separate housing" version, you are able to mount the housing with the electronics insert at a distance from the measuring point. This version facilitates trouble-free measurement

- Under particularly difficult measuring conditions (at installation locations that are cramped or difficult to access)
- If rapid cleaning of the measuring point is required and
- If the measuring point is exposed to vibrations.


You can choose between different cable versions:

- PE: 2 m (6.6 ft), 5 m (16 ft) and 10 m (33 ft)
- FEP: 5 m (16 ft).

Ordering information: Product Configurator, order code for "Additional options 2", version "G".

**Dimensions**

In the case of the "separate housing" version, the sensor is delivered with the process connection and cable ready mounted. The housing and a mounting bracket are enclosed as separate units. The cable is provided with a socket at both ends. These sockets are simply connected to the housing and the sensor.

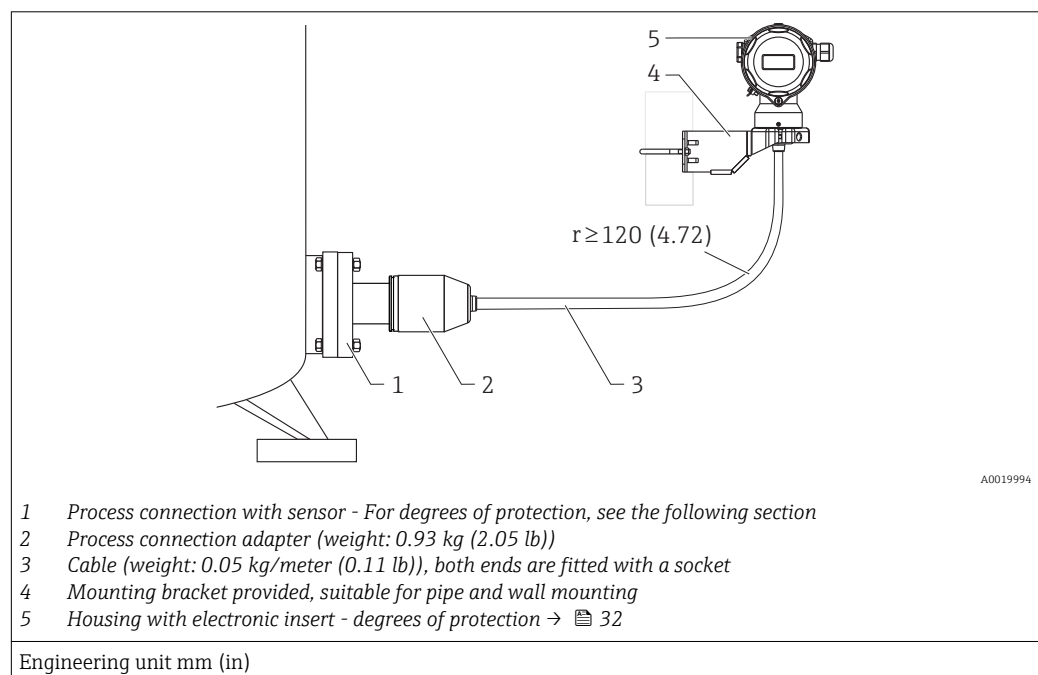

Degree of protection for the process connection and sensor with the use of

- FEP cable:
  - IP 69<sup>1)</sup>
  - IP 66 NEMA 4/6P
  - IP 68 (1.83 mH<sub>2</sub>O for 24 h) NEMA 4/6P
- PE cable:
  - IP 66 NEMA 4/6P
  - IP 68 (1.83 mH<sub>2</sub>O for 24 h) NEMA 4/6P

Technical data of the PE and FEP cable:

- Minimum bending radius: 120 mm (4.72 in)
- Cable extraction force: max. 450 N (101.16 lbf)
- Resistance to UV light


Use in hazardous area:

- Intrinsically safe installations (Ex ia/IS)
- FM/CSA IS: for Div. 1 installation only

1) Designation of the IP protection class according to DIN EN 60529. Previous designation "IP69K" according to DIN 40050 Part 9 is no longer valid (standard withdrawn on November 1, 2012). The tests required by both standards are identical.

**Reduction of the installation height**

If the separate housing is used, the installation height of the process connection is reduced compared to the dimensions of the standard version.

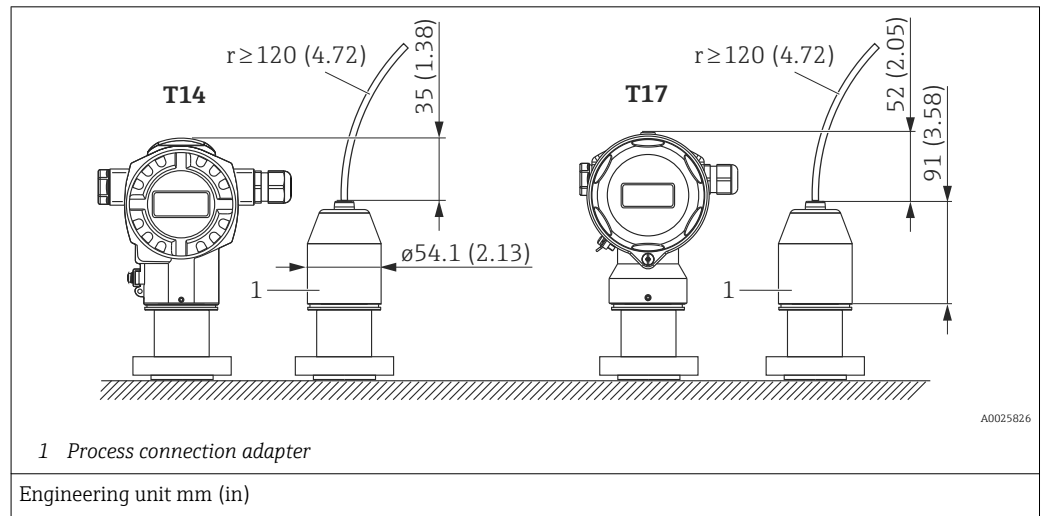


**Turning the housing**

The housing can be rotated up to 380° by loosening the Allen screw.

**Your benefits**

- Easy mounting due to optimum alignment of housing
- Good, accessible device operation
- Optimum readability of the onsite display (optional).

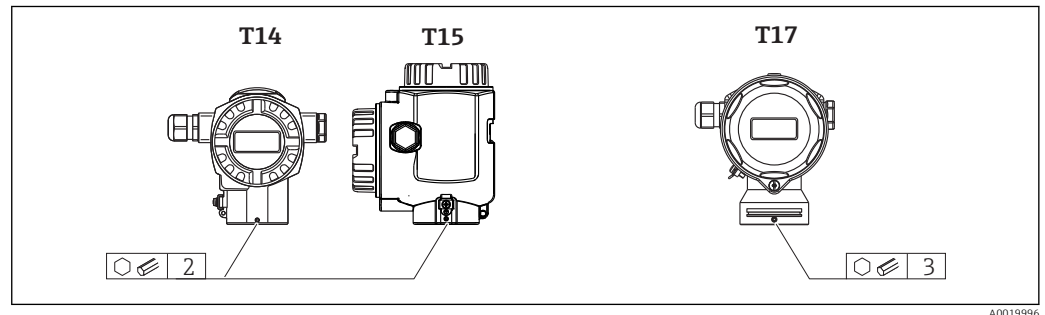

**PWIS-free applications**

Special cleaning of the transmitter to remove paint-wetting substances, for use in paint shops, for instance.

Ordering information:

Product Configurator, order code for "Fill fluid", option "L".

**Applications with hydrogen**

A **gold-plated** metal process isolating diaphragm offers universal protection against hydrogen diffusion, both in gas applications and in applications with aqueous solutions.

**Applications with hydrogen in aqueous solutions**

A **gold/rhodium-plated** metal process isolating diaphragm (AU/Rh) offers effective protection against hydrogen diffusion.

## Environment

- Ambient temperature range**
- -40 to +85 °C (-40 to +185 °F). Devices for lower temperatures available on request.
  - Local display: -20 to +70 °C (-4 to +158 °F). Extended temperature application range with restrictions in optical properties, such as display speed and contrast: -40 to +85 °C (-40 to +185 °F)
  - Separate housing: -20 to +60 °C (-4 to +140 °F) (installation without insulation)

### Hazardous areas

- For devices for use in hazardous areas, see Safety Instructions, Installation or Control Drawing → 62.
- Pressure measuring devices that have the usual explosion protection certificates (e.g. ATEX-/CSA-/FM-/IEC Ex,...) can be used in hazardous areas at ambient temperatures down to -50 °C (-58 °F). The functionality of the explosion protection is also guaranteed for ambient temperatures down to -50 °C (-58 °F).

- Storage temperature range**
- -40 to +90 °C (-40 to +194 °F)
  - Local display: -40 to +85 °C (-40 to +185 °F)
  - Separate housing: -40 to +60 °C (-40 to +140 °F)

- Degree of protection**
- Depends on the deployed
- Housing → 32
  - Separate housing → 28

- Climate class**
- Class 4K4H (air temperature: -20 to +55 °C (-4 to +131 °F), relative humidity: 4 to 100 %) fulfilled as per DIN EN 60721-3-4 (condensation possible.)

- Electromagnetic compatibility**
- Electromagnetic compatibility as per EN 61326 and NAMUR recommendation EMC (NE21).
  - Maximum deviation: < 0.5 % of span
  - All EMC measurements were performed with a turn down (TD) = 2:1.
- For further details refer to the Declaration of Conformity.

### Vibration resistance

Device/accessory	Test standard	Vibration resistance
FMB70	GL	Guaranteed for 3 to 25 Hz: ±1.6 mm (0.063 in); 25 to 100 Hz: 4 g in all 3 planes
FMB70 with mounting bracket	IEC 61298-3	Guaranteed for 10 to 60 Hz: ±0.15 mm (0.0059 in); 60 to 500 Hz: 2 g in all 3 planes

---

## Process

---

### Process temperature limits

- -10 to +100 °C (+14 to +212 °F)
- up to +135 °C (275 °F) short-term (maximum 30 minutes) for cleaning purposes

---

### Pressure specifications

**⚠ WARNING**

**The maximum pressure for the measuring device depends on the lowest-rated element with regard to pressure.**

- ▶ For pressure specifications, see the "Measuring range" section and the "Mechanical construction" section.
- ▶ The measuring device must be operated only within the specified limits!
- ▶ MWP (maximum working pressure): The MWP (maximum working pressure) is specified on the nameplate. This value refers to a reference temperature of +20 °C (+68°F) and may be applied to the device for an unlimited time. Observe temperature dependency of the MWP. The pressure values permitted at higher temperatures can be found in the standards EN 1092-1: 2001 Tab. 18 (With regard to their stability-temperature property, the materials 1.4435 and 1.4404 are grouped together under 13EO in EN 1092-1 Tab. 18. The chemical composition of the two materials can be identical.), ASME B 16.5a – 1998 Tab. 2-2.2 F316, ASME B 16.5a – 1998 Tab. 2.3.8 N10276, JIS B 2220.
- ▶ The test pressure corresponds to the over pressure limit of the individual sensors (OPL = 1.5 x MWP ) and may be applied only for a limited period of time to prevent any lasting damage.
- ▶ The Pressure Equipment Directive (2014/68/EU) uses the abbreviation "PS". The abbreviation "PS" corresponds to the MWP (maximum working pressure) of the measuring device.
- ▶ In the case of sensor range and process connections where the over pressure limit (OPL) of the process connection is smaller than the nominal value of the sensor, the device is set at the factory, at the very maximum, to the OPL value of the process connection. If you want to use the entire sensor range, select a process connection with a higher OPL value (1.5 x PN; MWP = PN)

## Mechanical construction

### Device height


The device height is calculated from

- the height of the housing
- the height of optional mounted parts such as temperature isolators or capillaries
- the height of the relevant process connection.

The individual heights of the components can be found in the following sections. To calculate the device height, simply add up the individual heights of the components. If necessary, the installation space (the space used to install the device) must also be taken into account. You can use the following table for this:

Section	Page	Height	Example
Height of housing	→ 32	(A)	
Process connections	→ 34	(H)	
Installation space	-	(I)	
Device height			

### T14 housing, optional display on the side

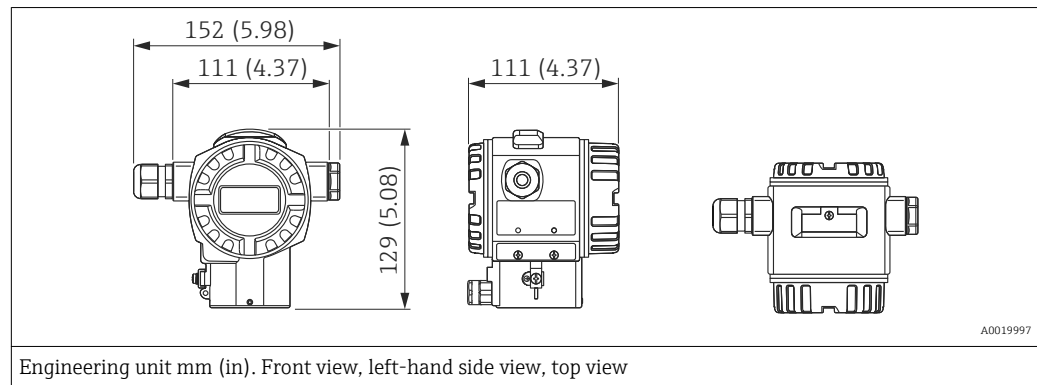


Material		Degree of protection	Cable entry	Weight in kg (lb)		Option <sup>1)</sup>
Housing	Cover seal			with display	without display	
Aluminum	EPDM	IP66/67 NEMA 6P	M20 gland	1.2 (2.65)	1.1 (2.43)	A
		IP66/67 NEMA 6P	G ½" thread			B
		IP66/67 NEMA 6P	NPT ½" thread			C
		IP66/67 NEMA 6P	M12 plug			D
		IP66/67 NEMA 6P	7/8" plug			E
		IP65 NEMA 4	HAN7D plug 90 degrees			F

1) Product Configurator, order code for "Housing, cover seal, cable entry, degree of protection"




**T15 housing, optional display on the top**

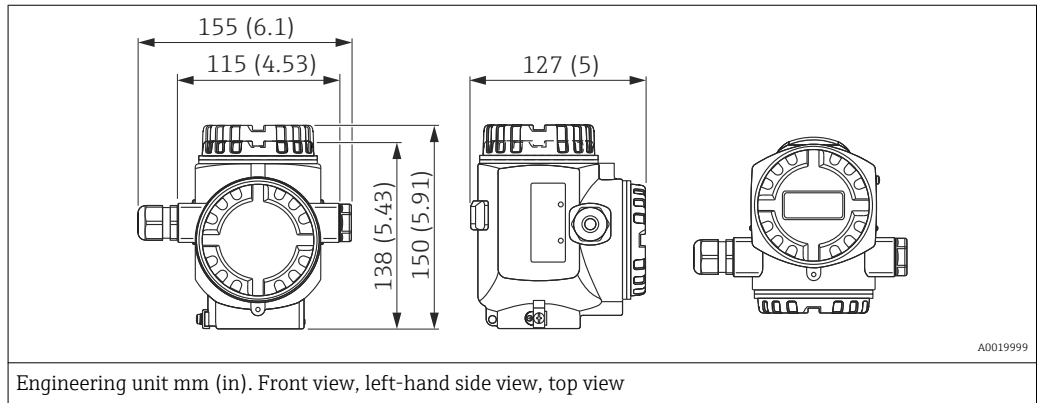

Material		Degree of protection	Cable entry	Weight in kg (lb)		Option <sup>1)</sup>
Housing	Cover seal			with display	without display	
Aluminum	EPDM	IP66/67 NEMA 6P	M20 gland	1.8 (3.97)	1.7 (3.75)	J
		IP66/67 NEMA 6P	G ½" thread			K
		IP66/67 NEMA 6P	NPT ½" thread			L
		IP66/67 NEMA 6P	M12 plug			M
		IP66/67 NEMA 6P	7/8" plug			N
		IP65 NEMA 4	HAN7D plug 90 degrees			P

1) Product Configurator, order code for "Housing, cover seal, cable entry, degree of protection"

**T17 housing (hygienic), optional display on the side**

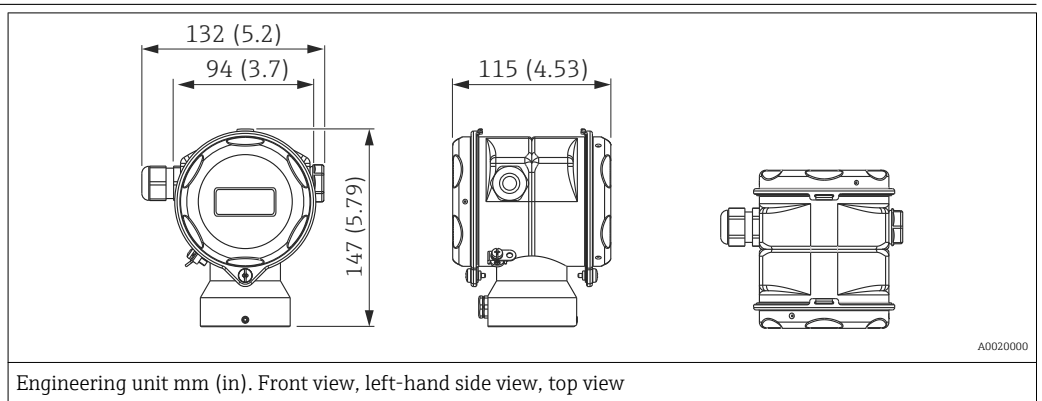


Material		Degree of protection <sup>1)</sup>	Cable entry	Weight in kg (lb)		Option <sup>2)</sup>
Housing	Cover seal			with display	without display	
316L	EPDM	IP66/68 NEMA 6P	M20 gland	1.2 (2.65)	1.1 (2.43)	R
		IP66/68 NEMA 6P	G ½" thread			S
		IP66/68 NEMA 6P	NPT ½" thread			T
		IP66/68 NEMA 6P	M12 plug			U
		IP66/68 NEMA 6P	7/8" plug			V

1) Degree of protection IP 68: 1.83 mH<sub>2</sub>O for 24 h

2) Product Configurator, order code for "Housing, cover seal, cable entry, degree of protection"

Process connections

Threaded connection ISO 228 G

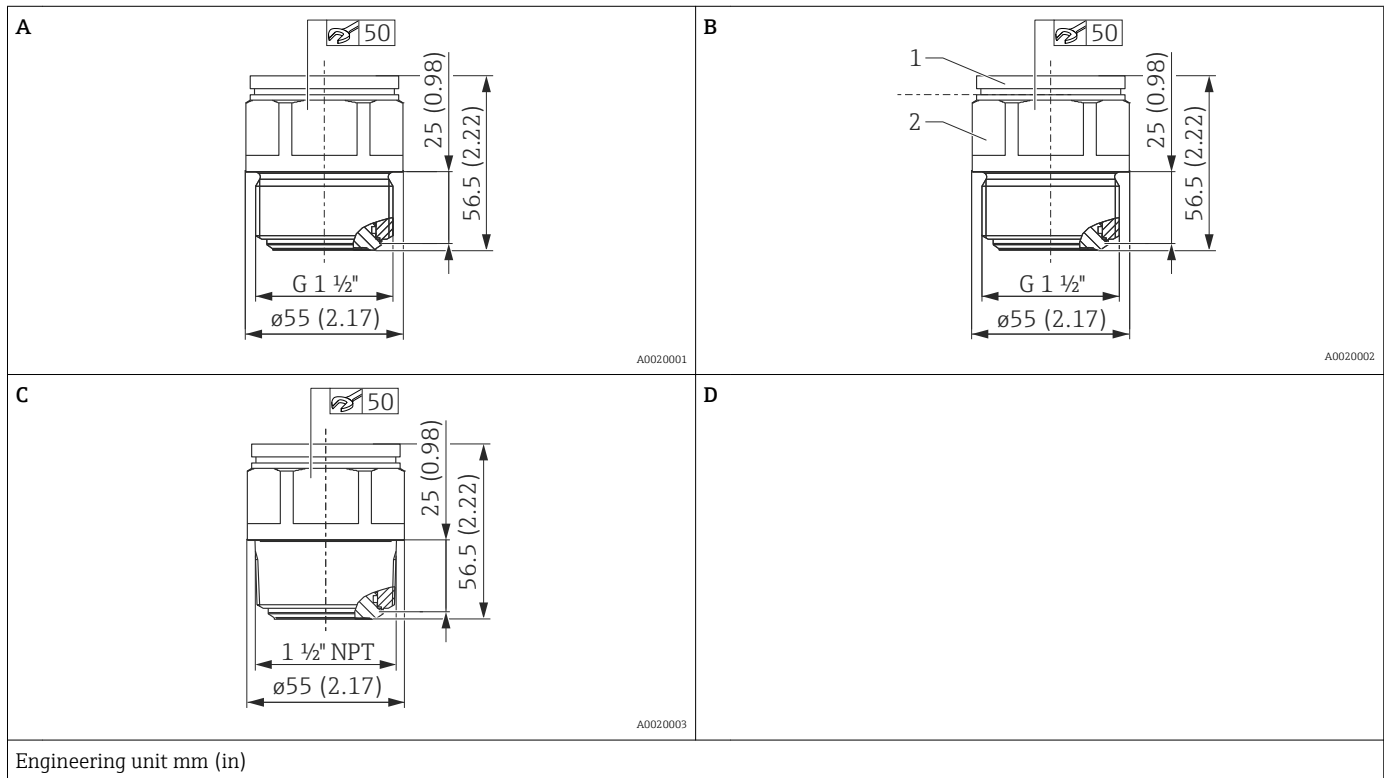


Item	Description	Material	Weight	Approval <sup>1)</sup>	Option <sup>2)</sup>
			kg (lb)		
A	Thread ISO 228 G 1 1/2" A	AISI 316L (1.4435)	0.8 (1.76)	-	1G
B	Thread ISO 228 G 1 1/2" A	<ul style="list-style-type: none"> <li>■ 1: Top section AISI 316L (1.4404)</li> <li>■ 2: Bottom section alloy C276 (2.4819)</li> </ul>	0.8 (1.76)	-	1H
C	Thread ANSI 1 1/2" MNPT	AISI 316L (1.4435)	0.8 (1.76)	CRN	2D

- 1) CSA approval: Product Configurator, order code for "Approval"
- 2) Product Configurator, order code for "Process connection"

Process connections


EN/DIN flanges, connection dimensions in accordance with EN 1092-1/DIN 2527, raised face RF

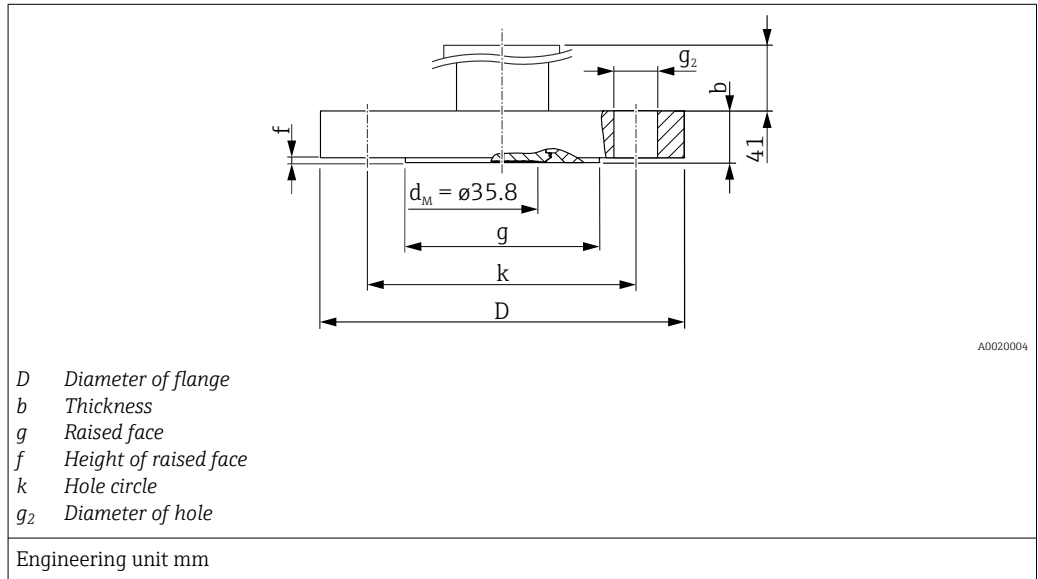

Flange <sup>1) 2)</sup>							Boltholes			Weight	Option <sup>3)</sup>
Nominal diameter	Nominal pressure	Form <sup>4)</sup>	D	b	g	f	Number	g <sub>2</sub>	k		
			[mm]	[mm]	[mm]	[mm]		[mm]	[mm]	[mm]	[kg (lb)]
DN 40	PN 10/16	B1 (C)	150	18	88	2	4	18	110	2.6 (5.73)	CE
DN 50	PN 10/16	B1 (C)	165	18	102	2	4	18	125	3.3 (7.28)	CF
DN 80	PN 10/16	B1 (C)	200	20	138	2	8	18	160	5.1 (11.25)	CG
DN 100	PN 10/16	B1 (C)	220	20	158	2	8	18	180	6.3 (13.89)	CH

- 1) The roughness of the surface in contact with the medium including the raised face of the flanges (all standards) is  $R_a < 0.8 \mu\text{m}$  (31.5  $\mu\text{in}$ ). Lower surface roughness available on request.
- 2) Material AISI 316L: Endress+Hauser supplies DIN/EN flanges in stainless steel as per AISI 316L (DIN/ EN material number 1.4404 or 14435). With regard to their stability-temperature property, the materials 1.4404 and 1.4435 are grouped together under 13E0 in EN 1092-1: 2001 Tab. 18. The chemical composition of the two materials can be identical.
- 3) Product Configurator, order code for "Process connection"
- 4) Designation as per DIN 2526 in brackets


## ASME flanges, connection dimensions in accordance with ASME B 16.5, raised face RF

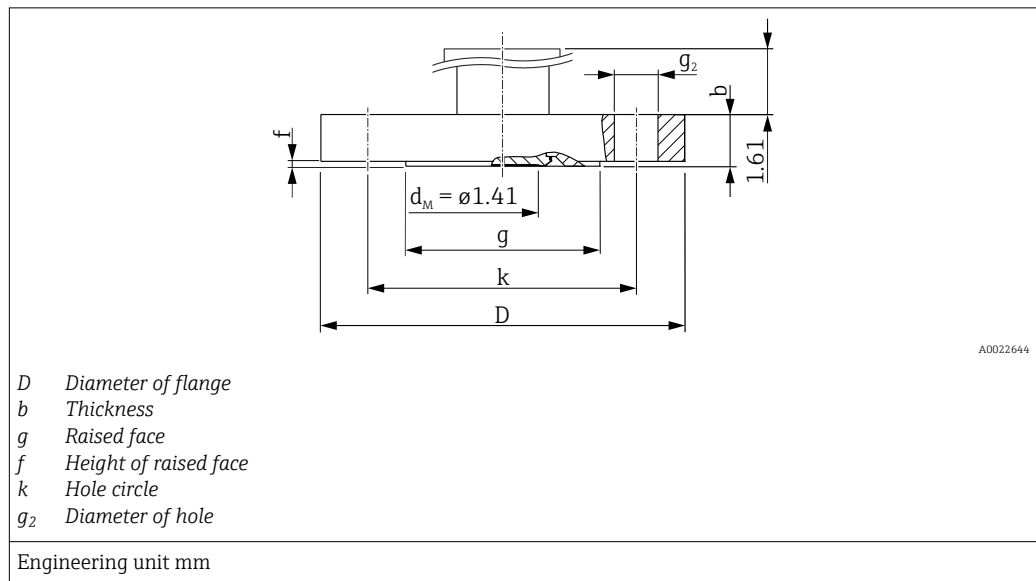

Flange <sup>1) 2)</sup>						Boltholes			Weight	Approval <sup>3)</sup>	Option <sup>4)</sup>
Nominal diameter	Class	D	b	g	f	Number	<i>g<sub>2</sub></i>	<i>k</i>			
[in]	[lb./sq in]	[in]	[in]	[in]	[in]			[in]	[in]	[kg (lb)]	
1.5	150	5	0.69	2.88	0.06	4	0.62	3.88	2.1 (4.63)	CRN	AE
2	150	6	0.75	3.62	0.06	4	0.75	4.75	3.0 (6.62)	CRN	AF
3	150	7.5	0.94	5	0.06	4	0.75	6	5.7 (12.57)	CRN	AG
4	150	9	0.94	6.19	0.06	8	0.75	7.5	7.8 (17.2)	CRN	AH

- 1) The roughness of the surface in contact with the medium including the raised face of the flanges (all standards) is  $R_a < 0.8 \mu\text{m}$  (31.5  $\mu\text{in}$ ). Lower surface roughness available on request.
- 2) Material AISI 316/316L: Combination of AISI 316 for required pressure resistance and AISI 316L for required chemical resistance (dual rated).
- 3) CSA approval: Product Configurator, order code for "Approval"
- 4) Product Configurator, order code for "Process connection"


JIS flanges, connection dimensions in accordance with JIS B 2220 BL, raised face RF

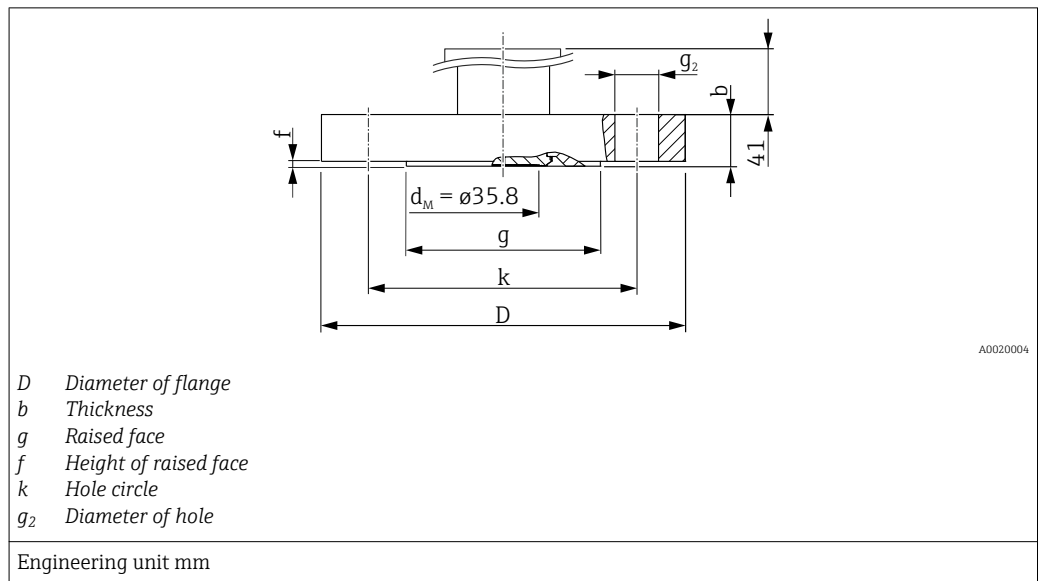

Flange <sup>1) 2)</sup>						Boltholes			Weight	Option <sup>3)</sup>
Nominal diameter	Nominal pressure	D	b	g	f	Number	g <sub>2</sub>	k		
		[mm]	[mm]	[mm]	[mm]		[mm]	[mm]		
40 A	10 K	140	16	81	2	4	19	105	2.1 (4.63)	KE
50 A	10 K	155	16	96	2	4	19	120	2.5 (5.51)	CF
80 A	10 K	185	18	126	2	8	19	150	3.8 (8.38)	KL
100 A	10 K	210	18	151	2	8	19	175	4.9 (10.8)	KH

- 1) The roughness of the surface in contact with the medium including the raised face of the flanges (all standards) is  $R_a < 0.8 \mu\text{m}$  (31.5  $\mu\text{in}$ ). Lower surface roughness available on request.
- 2) Material AISI 316L
- 3) Product Configurator, order code for "Process connection"

Hygienic connections

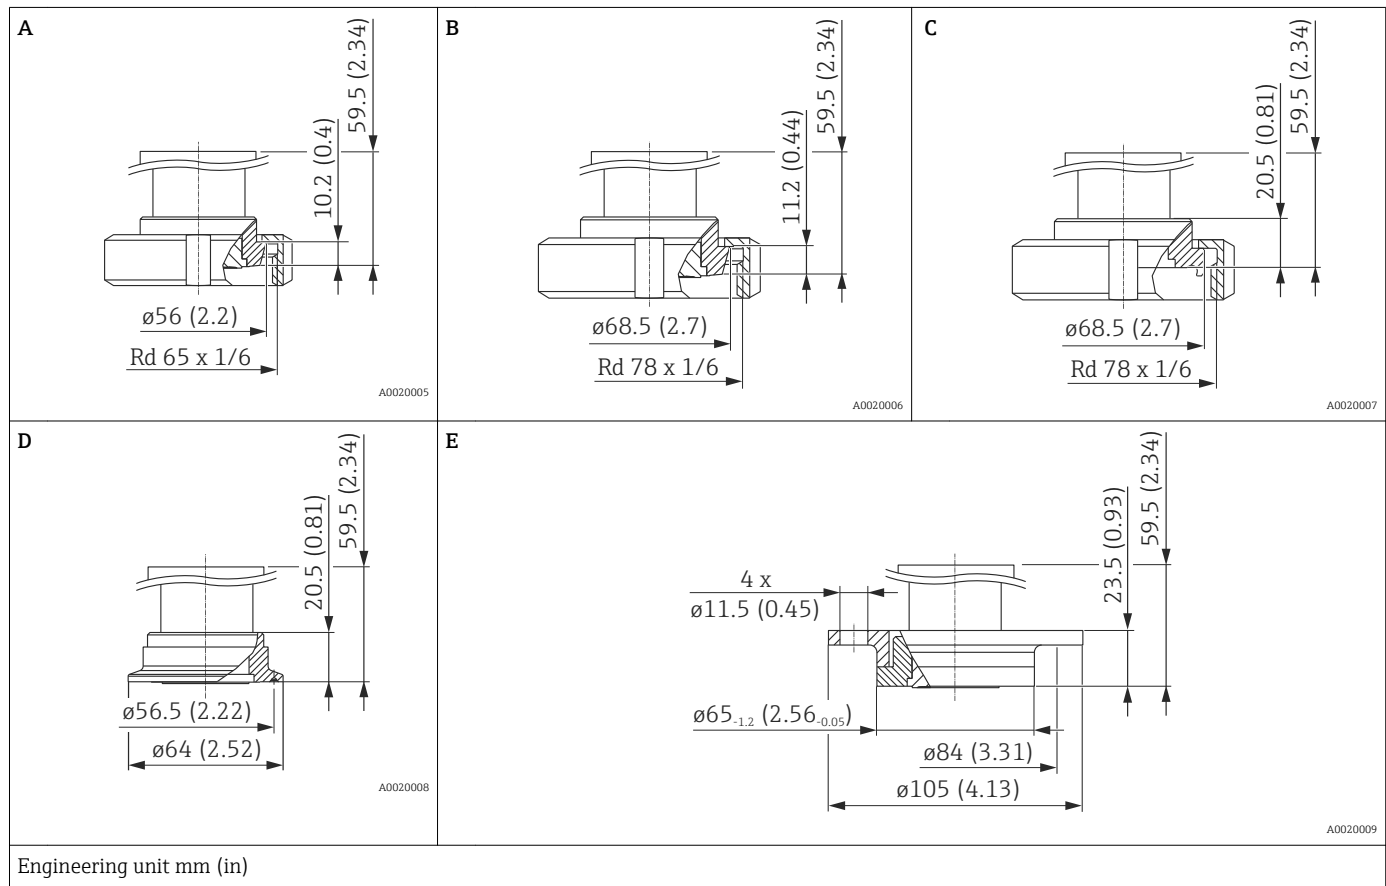


Position	Description	Nominal pressure	Material	Weight	Approval <sup>1)</sup>	Option <sup>2)</sup>
				kg (lb)		
A	DIN 11851 DN 40	PN 25	AISI 316L (1.4435)	0.7 (1.54)	EHEDG, 3A, CRN	M2 <sup>3)</sup>
B	DIN 11851 DN 50	PN 25		0.9 (1.98)		M3 <sup>3)</sup>
C	DIN 11864-1 A DN 50 Pipe DIN 11866-A, slotted nut	PN 16		1 (2.21)	EHEDG, 3A	ND <sup>3)</sup>
D	Tri-Clamp ISO 2852 DN 40 – DN 51 (2"), DIN 32676 DN 50	-		0.7 (1.54)	EHEDG, 3A, CRN	TD <sup>3)</sup>
E	DRD DN 50 (65 mm), slotted nut AISI 304 (1.4301)	PN 25		1.1 (1.98)	-	TK

1) CSA approval: Product Configurator, order code for "Approval"

2) Product Configurator, order code for "Process connection"


3) Endress+Hauser supplies these slotted nuts in stainless steel AISI 304 (DIN/EN material number 1.4301) or in AISI 304L (DIN/EN material number 1.4307).

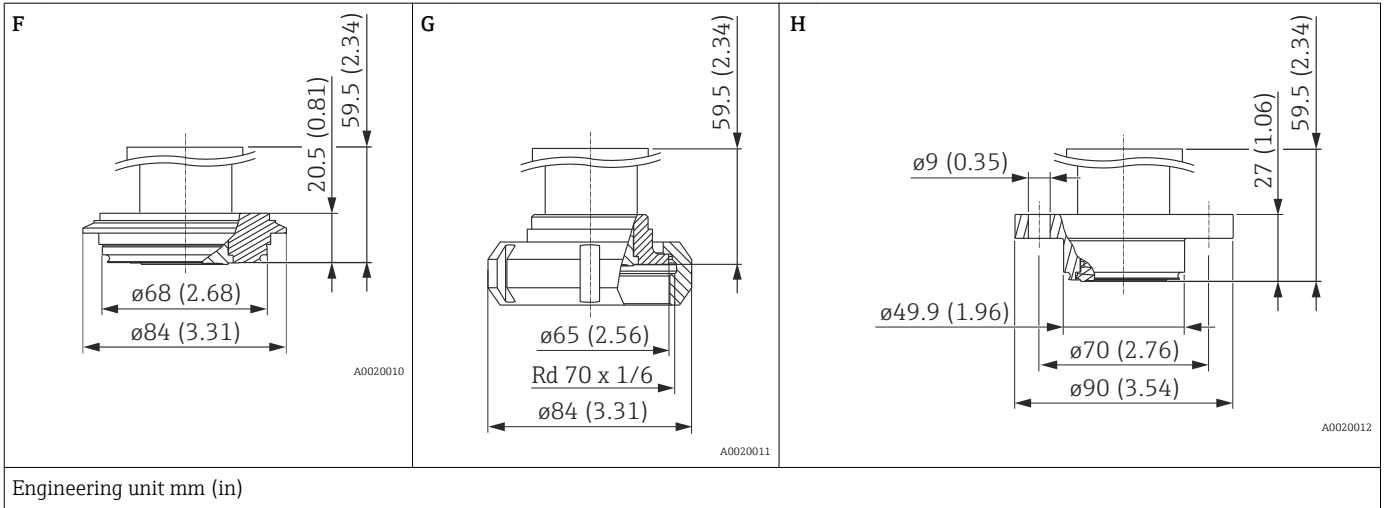

Position	Description	Nominal pressure	Material	Weight	Approval <sup>1)</sup>	Option <sup>2)</sup>
				kg (lb)		
F	Varivent type N for pipes 40 – 162	PN 40	AISI 316L (1.4435)	1 (2.21)	EHEDG, 3A, CRN	TR
G	SMS 2"	PN 25		0.7 (1.54)		EHEDG, 3A
H	NEUMO, D50	PN 16		0.8 (1.76)	3A	S4

- 1) CSA approval: Product Configurator, order code for "Approval"
- 2) Product Configurator, order code for "Process connection"
- 3) Endress+Hauser supplies these slotted nuts in stainless steel AISI 304 (DIN/EN material number 1.4301) or in AISI 304L (DIN/EN material number 1.4307).

Universal process adapter

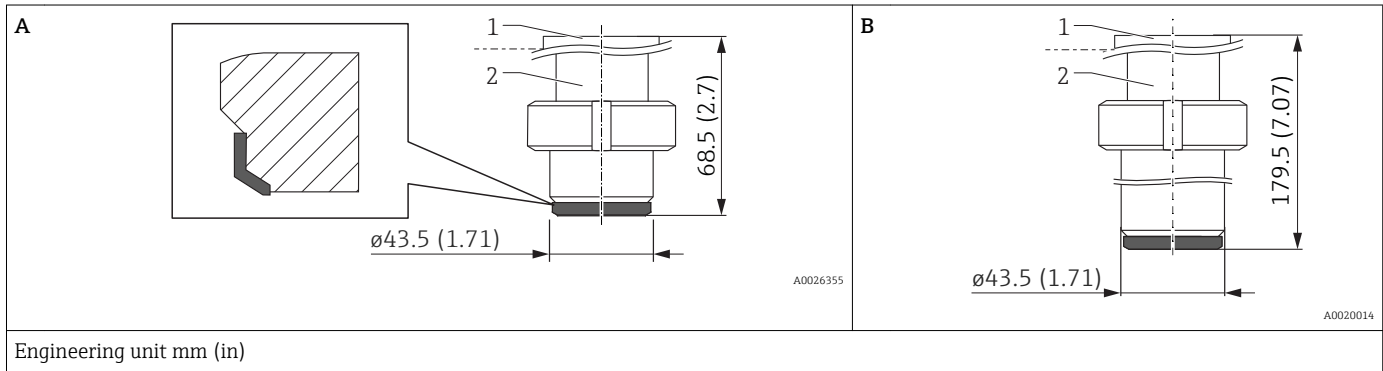

Engineering unit mm (in)

Position	Description	Nominal pressure	Material	Weight	Approval <sup>1)</sup>	Option <sup>2)</sup>
		bar (psi)		kg (lb)		
A	Universal process adapter with molded seal <sup>3)</sup> made of silicone	10 (145)	<ul style="list-style-type: none"> <li>▪ 1: Top section AISI 316L (1.4404)</li> <li>▪ 2: Bottom section AISI 316L (1.4435)</li> </ul>	0.8 (1.76)	EHEDG, 3A, CRN	00 <sup>4)</sup>
	Universal process adapter with molded seal <sup>5)</sup> made of EPDM					01 <sup>4)</sup>
B	Universal process adapter, 6 inch extension with silicone molded seal <sup>3)</sup>			1.7 (3.75)	EHEDG, 3A, CRN	57 <sup>4)</sup>
	Universal process adapter, 6 inch extension with EPDM molded seal <sup>5)</sup>					58 <sup>4)</sup>

1) CSA approval: Product Configurator, order code for "Approval"

2) Product Configurator, order code for "Process connection"


3) Molded seal FDA 21CFR177.2600/USP Class VI, EHEDG, 3A, spare parts number: 52023572

4) Endress+Hauser supplies these slotted nuts in stainless steel AISI 304 (DIN/EN material number 1.4301) or in AISI 304L (DIN/EN material number 1.4307).

5) Molded seal EPDM-70, FDA, USP Class VI; (5-part set), order number: 71100719




Anderson process adapter

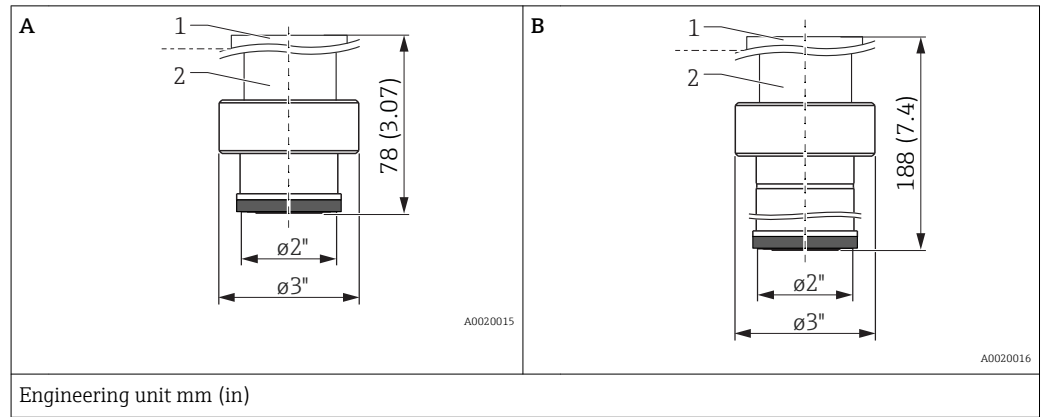

Position	Description	Nominal pressure	Material	Weight	Approval	Option <sup>1)</sup>
		bar (psi)		kg (lb)		
A	Anderson process adapter, short 2-3/16", incl. silicone molded seal	3.5 (50)	<ul style="list-style-type: none"> <li>■ 1: Top section AISI 316L (1.4404)</li> <li>■ 2: Bottom section AISI 316L (1.4435)</li> <li>■ Slotted nut AISI 316L (1.4404)</li> </ul>	0.8 (1.76)	3A	60
B	Anderson process adapter, long 6-1/2", incl. silicone molded seal			1.7 (3.75)		

1) Product Configurator, order code for "Process connection"

Separate housing: Wall and pipe mounting with mounting bracket

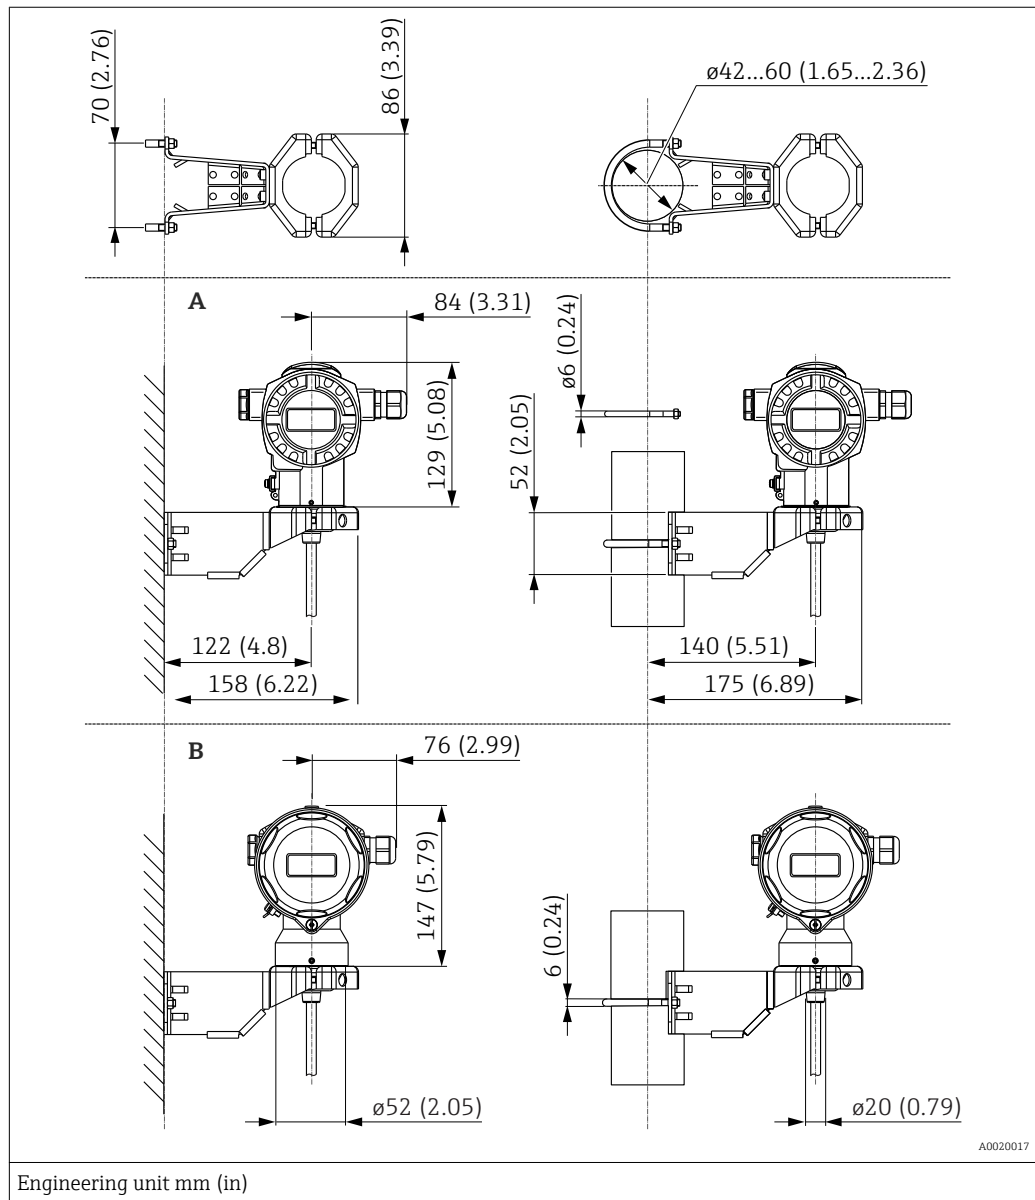


Position	Designation	Weight in kg (lb)		Option <sup>1)</sup>
		Housing (T14 or T17)	Mounting bracket	
A	Dimensions with T14 housing, optional side display	→ 32	0.5 (1.10)	U
B	Dimensions with T17 housing, optional side display			


1) Product Configurator, order code for "Additional options 2", version "G"

Also available for order as a separate accessory: part number 71102216

**Materials not in contact with process Transmitter housing**

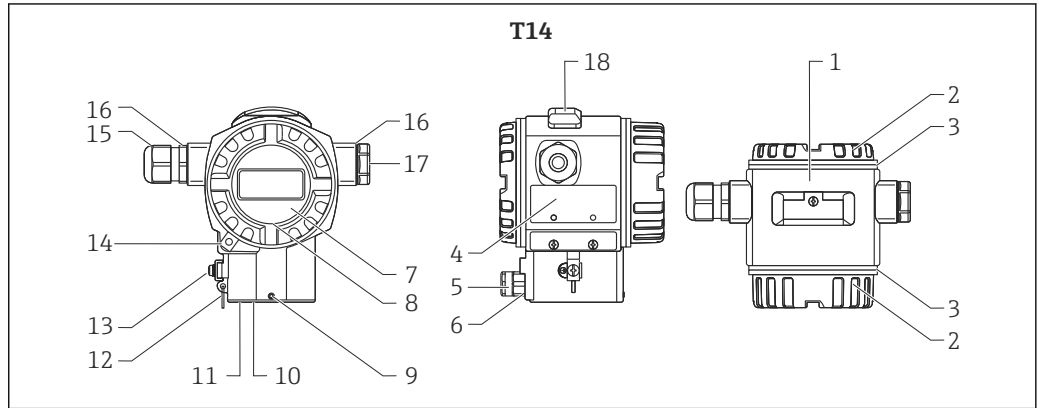


A0020019

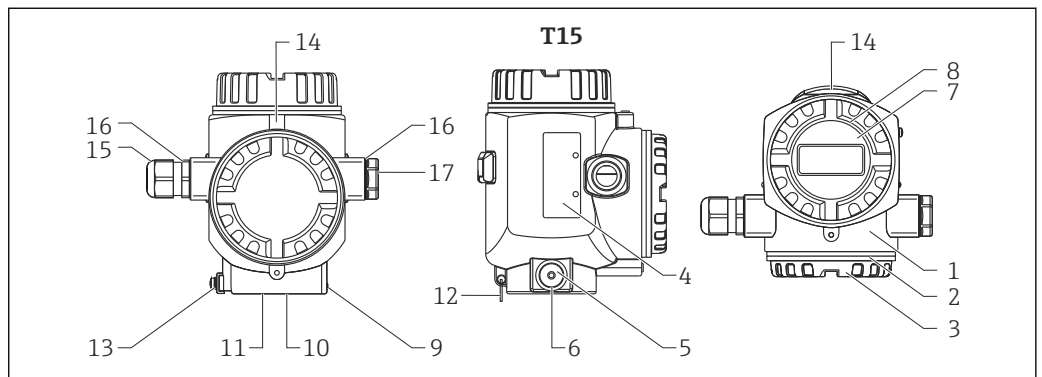

A0020020

Item number	Component part	Material
1	T14 and T15 housing, RAL 5012 (blue)	<ul style="list-style-type: none"> <li>Die-cast aluminum with protective powder-coating on polyester base</li> <li>Thread coating: Heat-curing lubricant varnish</li> </ul>
2	Cover, RAL 7035 (gray)	Die-cast aluminum with protective powder-coating on polyester base
3	Cover seal	EPDM
4	Nameplates	<ul style="list-style-type: none"> <li>AISI 316L (1.4404), if T14 housing is precision-cast</li> <li>Anodized aluminum, if housing T14/T15 of die-cast aluminum</li> </ul>
5	Pressure compensation filter	AISI 316L (1.4404) and PBT-FR
6	Pressure compensation filter, O-ring	VMQ or EPDM
7	Sight glass	Mineral glass
8	Sight glass seal	Silicone (VMQ)
9	Screw	A4
10	Sealing ring	EPDM
11	Snap ring	PA66-GF25
12	Snap ring for nameplates	AISI 304 (1.4301)/AISI 316 (1.4401)
13	External ground terminal	AISI 304 (1.4301)
14	Cover clamp	Clamp AISI 316L (1.4435), screw A4
15	Cable entry	Polyamide (PA) or CuZn nickel-plated
16	Seal of cable entry and plug	Silicone (VMQ)


Item number	Component part	Material
17	Blind plug	PBT-GF30 FR, for dust ignition-proof: AISI 316L (1.4435)
18	External operation (keys and key cover), RAL 7035 (gray)	Polycarbonate PC-FR, screw A4

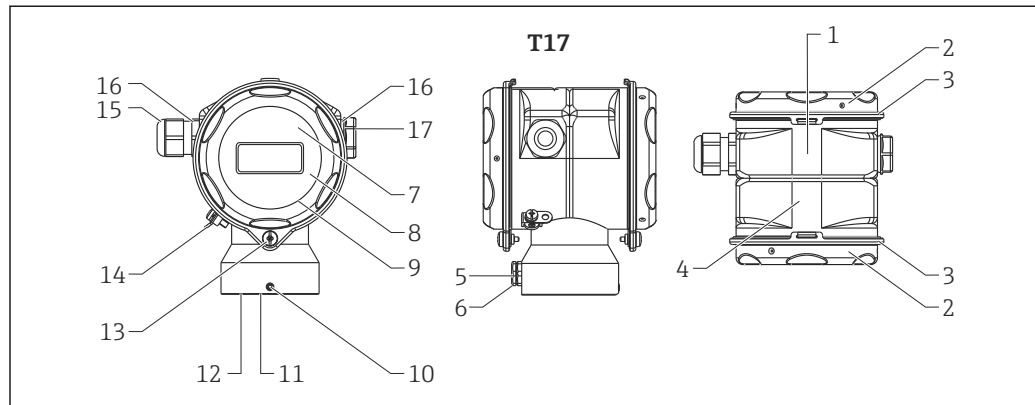

A0020021

Item number	Component part	Material
1	T17 housing	AISI 316L (1.4404)
2	Cover	
3	Cover seal	EPDM
4	Nameplates	Lasered on
5	Pressure compensation filter	AISI 316L (1.4404) and PBT-FR
6	Pressure compensation filter, O-ring	VMQ or EPDM
7	Sight glass for non-hazardous area, ATEX Ex ia, NEPSI Zone 0/1 Ex ia, IECEx Zone 0/1 Ex ia, FM NI, FM IS, CSA IS	Polycarbonate (PC)
8	Sight glass for ATEX 1/2 D, ATEX 1/3 D, ATEX 1 GD, ATEX 1/2 GD, ATEX 3 G, FM DIP, CSA dust ignition-proof	Mineral glass
9	Sight glass seal	EPDM
10	Screw	A2-70
11	Sealing ring	EPDM
12	Snap ring	PA6
13	Screw	A4-50 Thread coating: Heat-curing lubricant varnish
14	External ground terminal	AISI 304 (1.4301)
15	Cable entry	Polyamide (PA), for dust ignition-proof: CuZn nickel-plated
16	Seal of cable entry and plug	Silicone (VMQ)
17	Blind plug	PBT-GF30 FR, for dust ignition-proof: AISI 316L (1.4435)

Connecting parts

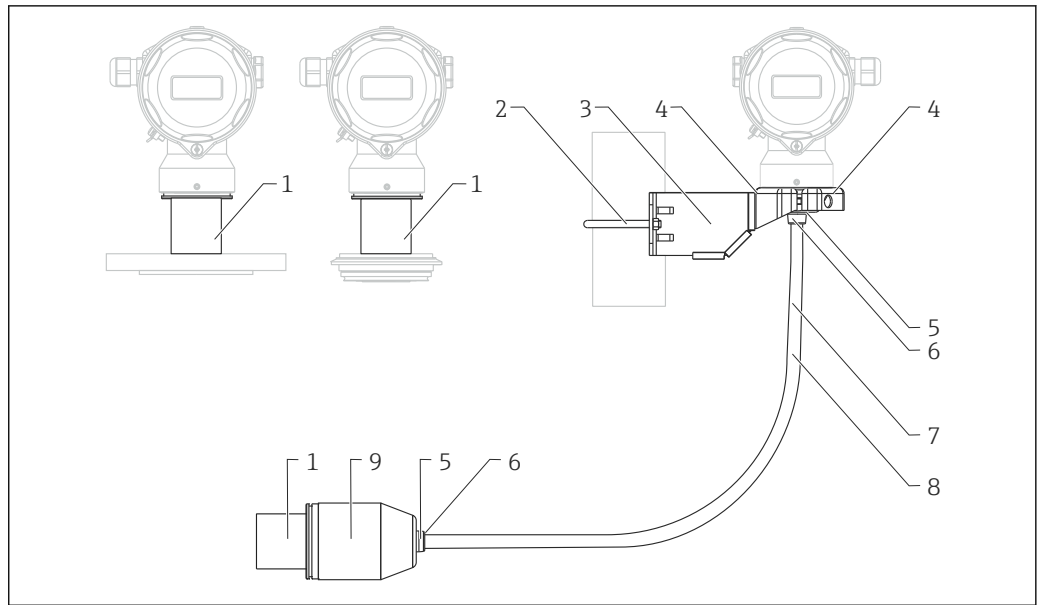

A0023954

Item number	Component part	Material
1	Connection between the housing and process connection	AISI 316L (1.4404)
2	Mounting bracket	Bracket AISI 316L (1.4404)
3		Screw and nuts A4-70
4		Half-shells: AISI 316L (1.4404)
5	Seal for cable from separate housing	EPDM
6	Gland for cable from separate housing	AISI 316L (1.4404)
7	PE cable for separate housing	abrasion-proof cable with strain-relief Dynema members; shielded using aluminum-coated foil; insulated with polyethylene (PE-LD), black; copper wires, twisted, UV-resistant
8	FEP cable for separate housing	Abrasion-proof cable; shielded using galvanized steel wire netting; insulated with fluorinated ethylene propylene (FEP), black; copper cores, twisted, UV-resistant
9	Process connection adapter for separate housing	AISI 316L (1.4404)

Weight

Component part	Weight
Housing	See "Housing" section
Process connection	See "Process connections" section

Materials in contact with process

**NOTICE**

- ▶ The device components in contact with the process are specified in the "Mechanical construction" → 32 and "Ordering information" → 58 sections.

Delta-ferrite content

A delta-ferrite content of  $\leq 3\%$  can be guaranteed and certified for the wetted parts if option "8" is selected in the "Additional options 1" or "Additional options 2" order code in the Product Configurator.

TSE Certificate of Suitability (Transmissible Spongiform Encephalopathy)

The following applies to all device components in contact with the process:

- They do not contain any materials derived from animals.
- No additives or operating materials derived from animals are used in production or processing.

#### Process isolating diaphragm

Designation	Option <sup>1)</sup>
Alloy C276 (2.4819), Ø 35.8 mm (1.41 in)	2
Alloy C276 (2.4819), Ø 35.8 mm (1.41 in), with gold-rhodium coating	6

1) Product Configurator, order code for "Material of process isolating diaphragm; seal."

#### Fill fluid

Designation	Option <sup>1)</sup>
Synthetic oil polyalphaolefin FDA 21 CFR 178.3620, NSF H1	C
Inert oil	F
Inert oil, cleaned for PWIS-free service	L

1) Product Configurator, order code for "Fill fluid"

## Operability

### Operating concept

#### Operator-oriented menu structure for user-specific tasks

- Commissioning
- Operation
- Diagnosis

#### Fast and safe commissioning

Guided menus for applications

#### Reliable operation

- Local operation possible in several languages
- Standardized operation at the device and in the operating tools
- Parameters relating to measured values can be locked/unlocked using the device's write protection switch, using the device software or via remote operation

#### Efficient diagnostics increase measurement availability

- Remedial measures are integrated in plain text
- Diverse simulation options

### Local operation

#### Functions

Function	External operation (operating keys, optional, not T17 housing)	Internal operation (electronic insert)	Onsite display (optional)
Position adjustment (zero point correction)	✓	✓	✓
Setting lower-range value and upper-range value - reference pressure present at the device	✓ (HART only)	✓ (HART only)	✓
Device reset	✓	✓	✓
Locking and unlocking parameters relevant to the measured value	—	✓	✓
Value acceptance indicated by green LED	✓	✓	✓
Switching damping on and off	✓ (only if display is connected)	✓ (HART and PA only)	✓
Configuring the bus address of the device (PA)	—	✓	✓
Switching simulation mode on and off (FOUNDATION Fieldbus)	—	✓	✓

#### Operating the device using onsite display (optional)

A 4-line liquid crystal display (LCD) is used for display and operation. The onsite display shows measured values, dialog text as well as fault and notice messages in plain text, thereby supporting the user in every stage of operation.

The display can be removed for easy operation.


The device display can be turned in 90° steps.

Depending on the installation position of the device, this makes it easy to operate the device and read the measured value.

## Functions:

- 8-digit measured value display including sign and decimal point and bar graph for
  - 4 to 20 mA HART (bar graph from 4 to 20 mA)
  - PROFIBUS PA (bar graph as graphic display of standardized value of AI block)
  - FOUNDATION Fieldbus (bar graph as graphic display of transducer output).
- 
- Simple and complete menu guidance due to breakdown of parameters into several levels and groups
- Menu guidance in up to 8 languages
- Each parameter is given a 3-digit ID number for easy navigation.
- Option for configuring the display according to individual requirements and preferences, such as language, alternating display, display of other measured values such as sensor temperature, contrast setting.
- Comprehensive diagnostic functions (fault and warning message, peak-hold indicators, etc.).
- Rapid and safe commissioning with the Quick Setup menus

## Overview

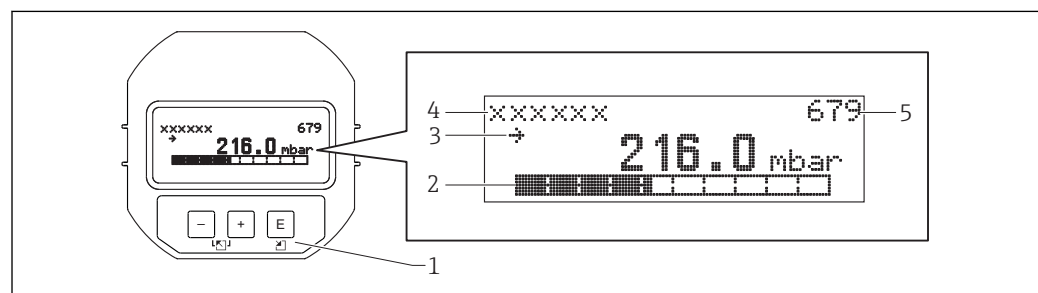


A0016498

- 1 Operating keys
- 2 Bargraph
- 3 Symbol
- 4 Header
- 5 Parameter ID number

## Operating keys on the exterior of the device

With the aluminum housing (T14), the operating keys are located either outside on the housing, under the protection cap or inside on the electronic insert. With the stainless steel housing (T17), the operating keys are always located inside the housing on the electronic insert.

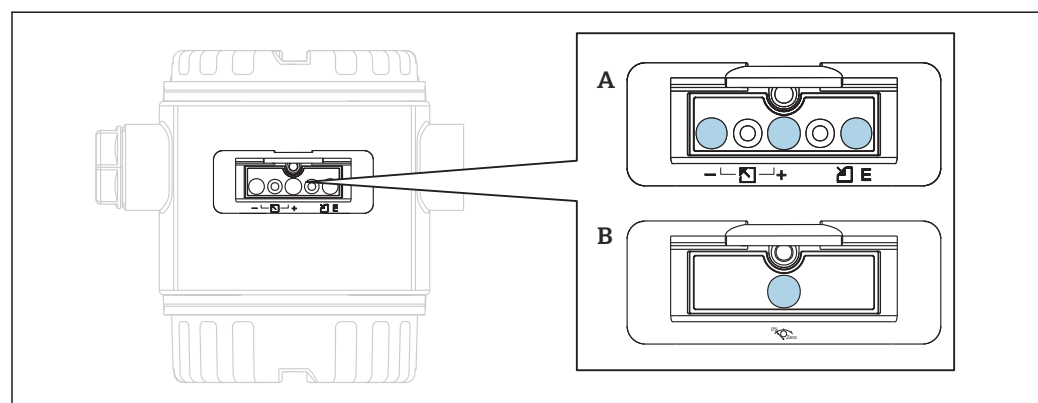

A0020030

- A 4 to 20 mA HART
- B PROFIBUS PA and FOUNDATION Fieldbus

The operating keys located externally on the device work on the Hall sensor principle. As a result, no additional openings are required in the device. This guarantees:

- Complete protection against environmental influences such as moisture and contamination.
- Simple operation without any tools.
- No wear.



Ordering information:


Product Configurator, order code for "Output, operation"

**Operating keys and elements located internally on the electronic insert**

Ordering information:

Product Configurator, order code for "Output, operation"


*HART*

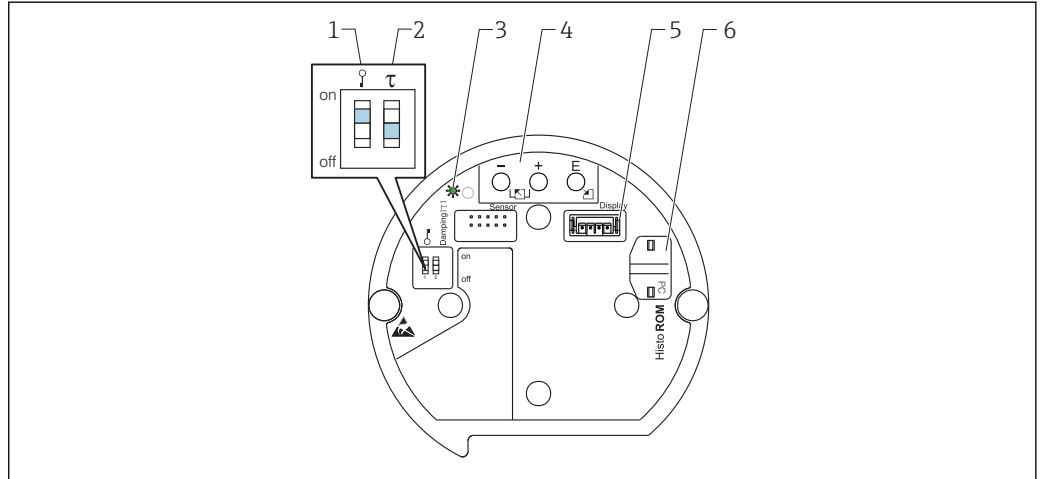

A0020031

- 1 *DIP switch for locking/unlocking parameters relevant to the measured value*
- 2 *DIP switch for switching damping on/off*
- 3 *Green LED to indicate value being accepted*
- 4 *Operating keys*
- 5 *Slot for optional display*
- 6 *Slot for optional HistoROM®/M-DAT*


*PROFIBUS PA*

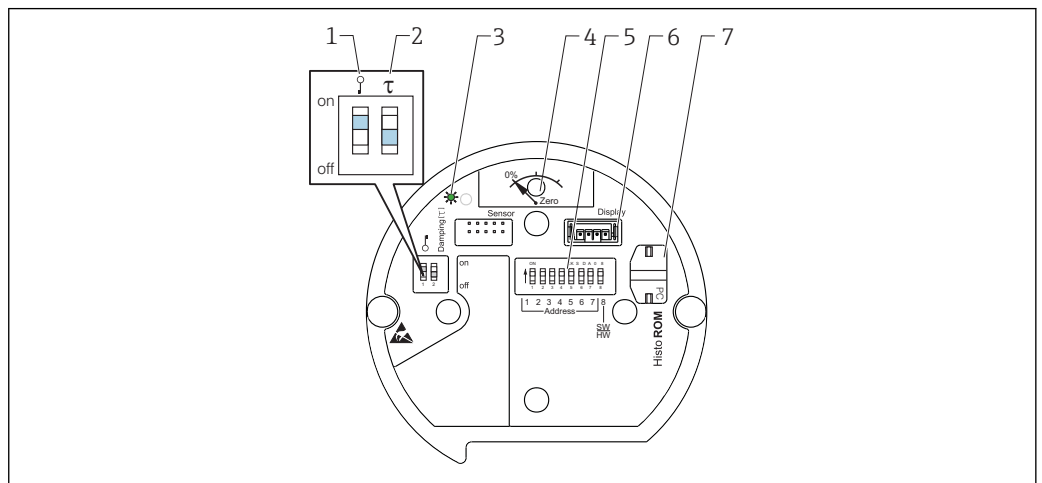

A0020032

- 1 *DIP switch for locking/unlocking parameters relevant to the measured value*
- 2 *DIP switch for switching damping on/off*
- 3 *Green LED to indicate value being accepted*
- 4 *Key for position adjustment and device reset*
- 5 *DIP switch for bus address*
- 6 *Slot for optional display*
- 7 *Slot for optional HistoROM®/M-DAT*

## FOUNDATION Fieldbus

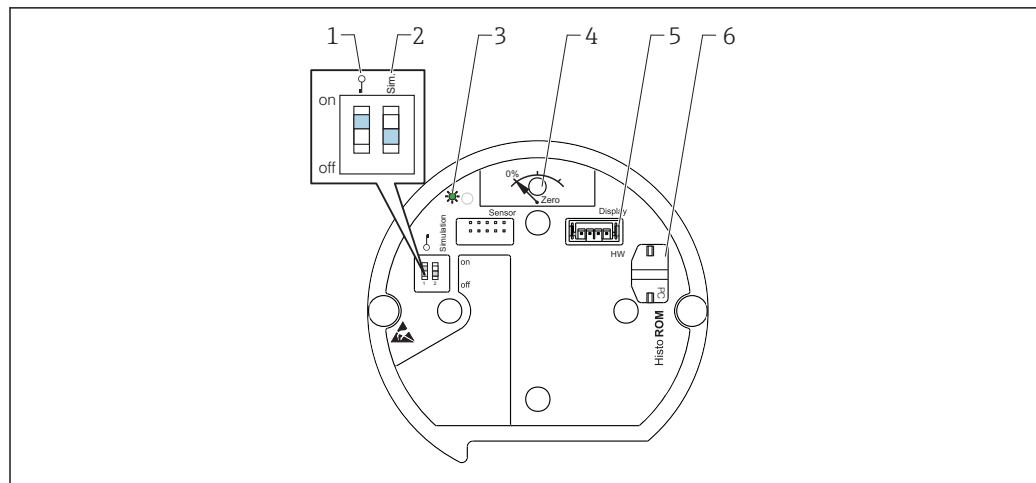

A0020033

- 1 DIP switch for locking/unlocking parameters relevant to the measured value
- 2 DIP switch for simulation mode on/off
- 3 Green LED to indicate value being accepted
- 4 Key for position adjustment and device reset
- 5 Slot for optional display
- 6 Slot for optional HistoROM®/M-DAT

## Remote operation

All software parameters are accessible depending on the position of the write protection switch on the device.

Hardware and software for remote operation	HART	PROFIBUS PA	FOUNDATION Fieldbus
FieldCare	✓	✓	✓
FieldXpert SFX100	✓	–	✓
NI-FBUS Configurator	–	–	✓
HistoROM®/M-DAT	✓	✓	✓

## FieldCare

FieldCare is an Endress+Hauser asset management tool based on FDT technology. With FieldCare, you can configure all Endress+Hauser devices as well as devices from other manufacturers that support the FDT standard.

FieldCare supports the following functions:

- Configuration of transmitters in offline and online mode
- Device data upload/download
- HistoROM®/M-DAT analysis
- Documentation of the measuring point

Connection options:

- HART via Commubox FXA195 and the USB interface of a computer
- PROFIBUS PA via segment coupler and PROFIBUS interface card
- Service interface with Commubox FXA291 and ToF adapter FXA291 (USB).



For further information please contact your local Endress+Hauser Sales Center.

## Field Xpert SFX100

Field Xpert is an industrial PDA with integrated 3.5" touchscreen from Endress+Hauser based on Windows Mobile. It offers wireless communication via the optional VIATOR Bluetooth modem from Endress+Hauser. Field Xpert also works as a stand-alone device for asset management applications. For details, refer to BA00060S/04/EN.

**Commubox FXA195**

For intrinsically safe HART communication with FieldCare via the USB interface. For details refer to TI00404F/00/EN.

**Commubox FXA291**

The Commubox FXA291 connects Endress+Hauser field devices with a CDI interface (=Endress+Hauser Common Data Interface) to the USB interface of a personal computer or a notebook. For details refer to TI00405C/07/EN.



For the following Endress+Hauser devices you need the "ToF adapter FXA291" as an additional accessory:

- Cerabar S PMC71, PMP7x
- Deltabar S PMD7x, FMD7x
- Deltapilot S FMB70

**ToF adapter FXA291**

The ToF adapter FXA291 connects the Commubox FXA291 with devices of the ToF platform, pressure equipment and Gammapilot via the USB interface of a personal computer or a notebook. For details refer to KA00271F.

**Profiboard**

For connecting a PC to PROFIBUS.

**Proficard**

For connecting a laptop to PROFIBUS.

**FF configuration program**

FF configuration program, such as NI-FBUS Configurator, to

- connect devices with "FOUNDATION Fieldbus signal" into an FF network
- set FF-specific parameters

*Remote operation via the NI-FBUS Configurator:*

The NI-FBUS Configurator is an easy-to-use graphical environment for creating linkages, field-based control loops and schedules based on the FOUNDATION Fieldbus concept.

You can use the NI-FBUS Configurator to configure a fieldbus network as follows:

- Set block and device tags
- Set device addresses
- Create and edit function block control strategies (function block applications)
- Configure vendor-defined function and transducer blocks
- Create and edit schedules
- Read and write to function block control strategies (function block applications)
- Invoke Device Description (DD) methods
- Display DD menus
- Download a configuration
- Verify a configuration and compare it to a saved configuration
- Monitor a downloaded configuration
- Replace a virtual device by a real device
- Save and print a configuration

---

**HistoROM®/M-DAT  
(optional)**

The HistoROM®/M-DAT is a memory module that can be attached to any electronic insert. HistoROM®/M-DAT can be retrofitted at any stage (order number: 52027785).

Your benefits

- Quick and safe commissioning of the same measuring points by copying the configuration data of one transmitter to another transmitter
- Reliable process monitoring thanks to cyclical recording of pressure and sensor temperature measured values
- Simple diagnosis by recording diverse events such as alarms, configuration changes, counters for measuring range undershoot and overshoot for pressure and temperature as well as user limit overshoot and undershoot for pressure and temperature etc.
- Analysis and graphic evaluation of the events and process parameters via software (contained in scope of supply).

A CD with an Endress+Hauser operating program is also included in the scope of delivery. You can copy data from one transmitter to another transmitter when operating a FOUNDATION Fieldbus device via an FF configuration program. You need the Endress+Hauser FieldCare operating program, the Commubox FXA291 service interface and the ToF adapter FXA291 to be able to access the data and events saved in the HistoROM®/M-DAT.

Ordering information:

Product Configurator, order code for "Additional options:", version "N" or

Product Configurator, order code for "Application package:", option "EN" or

as a separate accessory (part no.: 52027785).



For further information please contact your local Endress+Hauser Sales Center.


## System integration


The device can be given a tag name (max. 8 alphanumeric characters).

Description	Option <sup>1)</sup>
Measuring point (TAG), see additional spec.	Z1
Bus address, see additional spec.	Z2

1) Product Configurator, order code for "Identification"

## Certificates and approvals

<b>CE mark</b>	The device meets the legal requirements of the relevant EC directives. Endress+Hauser confirms that the device has been successfully tested by applying the CE mark.
<b>RCM-Tick marking</b>	<p>The supplied product or measuring system meets the ACMA (Australian Communications and Media Authority) requirements for network integrity, interoperability, performance characteristics as well as health and safety regulations. Here, especially the regulatory arrangements for electromagnetic compatibility are met. The products are labelled with the RCM- Tick marking on the name plate.</p> <div data-bbox="497 533 1533 667" style="border: 1px solid black; text-align: center; padding: 10px;">  </div> <p style="text-align: right; font-size: small;">A0029561</p>
<b>Ex approvals</b>	<ul style="list-style-type: none"> <li>▪ ATEX</li> <li>▪ FM</li> <li>▪ CSA</li> <li>▪ NEPSI</li> <li>▪ IECEX</li> <li>▪ TIIS</li> <li>▪ Also combinations of different approvals</li> </ul> <p>All explosion protection data are given in separate documentation which is available upon request. The Ex documentation is supplied as standard with all Ex devices → <a href="#">62</a>.</p>
<b>EAC conformity</b>	<p>The measuring system meets the legal requirements of the applicable EAC guidelines. These are listed in the corresponding EAC Declaration of Conformity together with the standards applied.</p> <p>Endress+Hauser confirms successful testing of the device by affixing to it the EAC mark.</p>
<b>Suitable for hygiene applications</b>	<p>The device is available with hygienic process connections (overview: see order code). The materials of the hygienic process connections in contact with foodstuffs comply with framework Regulation (EC) 1935/2004.</p> <p><b>⚠ CAUTION</b></p> <p><b>Contamination in the process!</b> Risk of contamination if incorrect seals and parts are used!</p> <ul style="list-style-type: none"> <li>▶ To avoid the risk of contamination, when installing the device comply with the design principles of EHEDG, Guideline 37 "Hygienic Design and Application of Sensors" and Guideline 16 "Hygienic Pipe Couplings".</li> <li>▶ Suitable assemblies and seals must be used to ensure hygienic design in accordance with 3-A SSI and EHEDG specifications.</li> <li>▶ The leak-proof connections can be cleaned with the cleaning methods typical of this industry (CIP and SIP). Attention must be paid to the pressure and temperature specifications of the sensor and process connections for CIP and SIP processes (clean in place/sterilize in place).</li> <li>▶ For diaphragm seal devices with 3-A and EHEDG certificates, only select filling oils with FDA approval!</li> </ul>

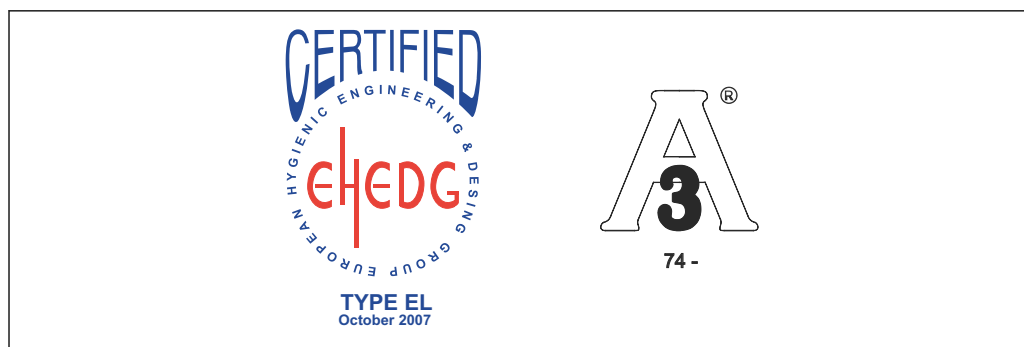

A0026782

 The gap-free connections can be cleaned of all residue using the usual cleaning methods within this industry.

#### Functional safety SIL/ IEC 61508 Declaration of Conformity (optional)

The Deltapilot S devices with a 4 to 20 mA output signal have been developed in accordance with the IEC 61508 standard. These devices can be used to monitor the process level and pressure up to SIL 3. For a detailed description of the safety functions with Deltapilot S, settings and functional safety data, see the "Functional safety manual - Deltapilot S" SD00213P/00.

For devices up to SIL 3 / IEC 61508 Declarations of Conformity see:

Ordering information:

Product Configurator, order code for "Additional options 1" and "Additional options 2", version "E".

#### Overfill protection

WHG (see document ZE00266P/00/EN)

Ordering information:

Product Configurator, order code for "Approval", option "6".

#### CRN approval

Some device versions have CRN approval. A CRN-approved process connection with a CSA approval must be ordered for a CRN-approved device. These devices are fitted with a separate nameplate with the registration number CRN OF1987.7C.

Ordering information:

Product Configurator, order code for "Process connection; material" and

Product Configurator, order code for "Approval" (only in conjunction with an approved process connection)

#### Other standards and guidelines

The applicable European guidelines and standards can be found in the relevant EU Declarations of Conformity. The following were also applied:

##### DIN EN 60770 (IEC 60770):

Transmitters for use in industrial-process control systems. Part 1: Methods for operating performance evaluation

##### DIN 16086:

Electrical pressure measuring instruments, pressure sensors, pressure transmitters, pressure measuring instruments, concepts, specifications on data sheets

##### EN 61326-X:

EMC product family standard for electrical equipment for measurement, control and laboratory use.

##### EN 60529:

Degrees of protection provided by enclosures (IP code)

#### Pressure Equipment Directive 2014/68/EU (PED)

##### Pressure equipment with allowable pressure $\leq 200$ bar (2 900 psi)

Pressure equipment (having a maximum allowable pressure  $PS \leq 200$  bar (2 900 psi)) can be classified as pressurized equipment in accordance with Pressure Equipment Directive 2014/68/EU. If the maximum allowable pressure is  $\leq 200$  bar (2 900 psi) and the pressurized volume of the pressure

equipment is  $\leq 0.1$  l, the pressure equipment is subject to the Pressure Equipment Directive (cf. Pressure Equipment Directive 2014/68/EU, Article 4, point 3). The Pressure Equipment Directive only requires that the pressure equipment shall be designed and manufactured in accordance with the "sound engineering practice of a Member State".

Reasons:

- Pressure Equipment Directive (PED) 2014/68/EU Article 4, point 3
- Pressure equipment directive 2014/68/EU, Commission's Working Group "Pressure", Guideline A-05 + A-06

Note:

A partial examination shall be performed for pressure instruments that are part of safety equipment for the protection of a pipe or vessel from exceeding allowable limits (equipment with safety function in accordance with Pressure Equipment Directive 2014/68/EU, Article 2, point 4).


**Manufacturer declarations**

Depending on the desired configuration, the following documents can be ordered additionally with the device:

- FDA conformity
- TSE-free: materials free from animal origin
- Regulation (EC) No. 2023/2006 (GMP)
- Regulation (EC) No. 1935/2004 on materials and articles intended to come into contact with food

**Downloading the Declaration of Conformity**

<http://www.endress.com/en/download>

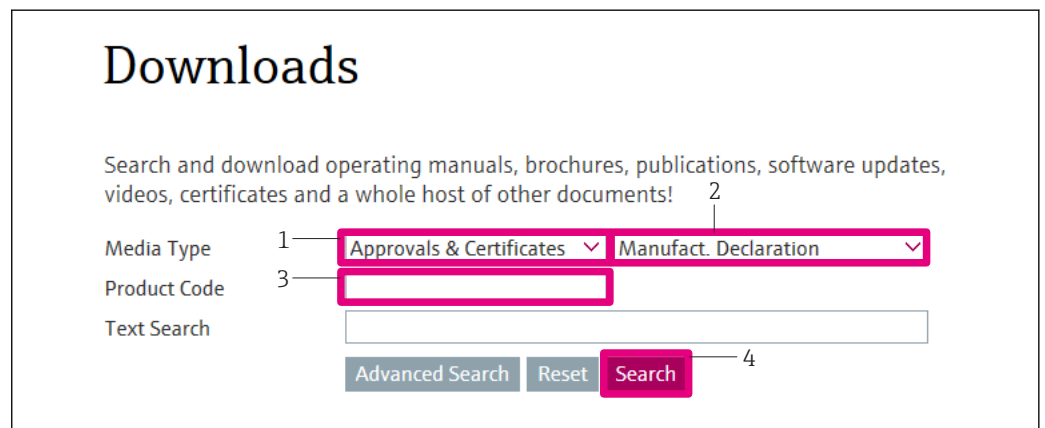

1. Select "Approvals & Certificates"
2. Select "Manufact. Declaration"
3. Enter the required product code
4. Click "Search"

The available downloads are displayed.

**Marine approval**

GL (German Lloyd)

Ordering information:

Product Configurator, order code for "Additional options 1" or "Additional options 2", version "S".

**Drinking water approval**

NSF 61 approval

Ordering information:

Product Configurator, order code for "Additional options 1" or "Additional options 2", version "F".

**Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ISA 12.27.01**

Endress+Hauser devices are designed in accordance with ANSI/ISA 12.27.01, allowing the user to waive the use and save the cost of installing external secondary process seals in the conduit as required by the process sealing sections of ANSI/NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North American installation practice and provide a very safe and cost-saving installation for pressurized applications with hazardous fluids. Please refer to the following table for the seal class assigned (single seal or dual seal):

Device	Approval	Single seal MWP
FMB70	CSA C/US IS	10 bar (150 psi)

Further information can be found in the control drawings of the relevant devices.

**Inspection certificate**

Designation	Option
3.1 Material documentation, wetted metal parts, EN10204-3.1 inspection certificate	B <sup>1) 3)</sup>
Individual test, test report	3 <sup>1)</sup>
Pressure test, internal procedure, test report	4 <sup>1)</sup>
EN10204-3.1 material wetted parts +Ra, Ra= surface roughness, dimensional check, inspection certificate	6 <sup>1)</sup>
Delta-Ferrit measurement, internal procedure, wetted metallic parts, inspection certificate	8 <sup>1)</sup>
3.1 Material documentation, wetted metal parts, EN10204-3.1 inspection certificate	JA <sup>2) 3)</sup>
PMI test (XRF), internal procedure, metal parts in contact with the medium	KG <sup>2)</sup>
Surface finish measurement ISO4287/Ra, wetted metal parts, inspection certificate	KB <sup>2)</sup>
Helium leak test, internal procedure, inspection certificate	KD <sup>2)</sup>
Pressure test, internal procedure, inspection certificate	KE <sup>2)</sup>
Delta-Ferrit measurement, internal procedure, wetted metallic parts, inspection certificate	KF <sup>2)</sup>

- 1) Product Configurator, order code for "Additional options 1" and "Additional options 2"
- 2) Product Configurator, order code for "Test, Certificate"
- 3) The choice of this feature for coated process isolating diaphragms/process connections refers to the metal base material.

**Calibration**

Designation	Option <sup>1)</sup>
Sensor range; %	A
Factory calibration certificate, 5-point; see additional specification	C
DKD/DAkkS certificate; see additional specification	D
Customized pressure; see additional specification	E
Customized level; see additional specification	F
Customized pressure + 5-point factory calibration certificate; see additional specification	H
Customized level + 5-point factory calibration certificate; see additional specification	I
Platinum; see additional specification	K
Platinum + factory calibration certificate 5-point; see additional specification	L
Platinum + DKD/DAkkS certificate; see additional specification	M
Sensor range; mbar/bar	1
Sensor range; kPa/MPa	2
Sensor range; mmH <sub>2</sub> O/mH <sub>2</sub> O	3
Sensor range; inH <sub>2</sub> O/ftH <sub>2</sub> O	4
Sensor range; psi	6

- 1) Product Configurator, order code for "Calibration; unit"



**Service**

Designation	Option <sup>1)</sup>
Cleaned of oil+grease <sup>2)</sup>	HA
Cleaned for oxygen service <sup>2)</sup>	HB
Cleaned of PWIS (paint-wetting impairment substances) <sup>2)</sup>	HC

- 1) Product Configurator, order code for "Service"  
 2) Device only, not accessories or enclosed accessories.

**Certificate of Compliance  
 ASME BPE 2012**

Ordering information: Product Configurator, order code for "Additional approval" option "LW".

## Ordering information

Detailed ordering information is available from the following sources:

- In the Product Configurator on the Endress+Hauser website: [www.endress.com](http://www.endress.com) -> Click "Corporate" -> Select your country -> Click "Products" -> Select the product using the filters and search field -> Open product page -> The "Configure" button to the right of the product image opens the Product Configurator.
- From your Endress+Hauser Sales Center: [www.addresses.endress.com](http://www.addresses.endress.com)

### Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
  - Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
  - Automatic verification of exclusion criteria
  - Automatic creation of the order code and its breakdown in PDF or Excel output format
  - Ability to order directly from the Endress+Hauser Online Shop

#### Scope of delivery

- Measuring device
- Optional accessories
- Brief Operating Instructions
- Certificates of calibration
- Optional certificates

#### Measuring point (TAG)

<b>Order code for</b>	895: Marking
<b>Option</b>	Z1: Tagging (TAG), see additional spec.
<b>Location of measuring point identification</b>	To be selected in the additional specification: <ul style="list-style-type: none"> <li>▪ Tie-on label, stainless steel</li> <li>▪ Adhesive paper label</li> <li>▪ Label provided</li> <li>▪ RFID TAG</li> <li>▪ RFID TAG + tie-on label, stainless steel</li> <li>▪ RFID TAG + adhesive paper label</li> <li>▪ RFID TAG + label provided</li> </ul>
<b>Definition of measuring point identification</b>	To be specified in additional specification: 3 lines each with a maximum of 18 characters  The measuring point designation appears on the selected label and/or the RFID TAG.
<b>Identification on electronic nameplate (ENP)</b>	32 characters
<b>Identification on display module</b>	10 characters

**Configuration data sheet**

**Pressure**

The following configuration data sheet must be completed and included with the order if the option "E" or "H" has been selected in the Product Configurator, order code for "Calibration; Unit".

Pressure unit				
<input type="checkbox"/> mbar	<input type="checkbox"/> mmH <sub>2</sub> O <sup>1)</sup>	<input type="checkbox"/> mmHg <sup>2)</sup>	<input type="checkbox"/> Pascal	<input type="checkbox"/> torr
<input type="checkbox"/> bar	<input type="checkbox"/> mH <sub>2</sub> O <sup>1)</sup>	<input type="checkbox"/> inHg <sup>2)</sup>	<input type="checkbox"/> hPa	<input type="checkbox"/> g/cm <sup>2</sup>
<input type="checkbox"/> psi	<input type="checkbox"/> ftH <sub>2</sub> O <sup>1)</sup>	<input type="checkbox"/> gf/cm <sup>2</sup>	<input type="checkbox"/> kPa	<input type="checkbox"/> kg/cm <sup>2</sup>
	<input type="checkbox"/> inH <sub>2</sub> O <sup>1)</sup>	<input type="checkbox"/> kgf/cm <sup>2</sup>	<input type="checkbox"/> MPa	<input type="checkbox"/> lb/ft <sup>2</sup>
				<input type="checkbox"/> atm

- 1) The conversion factor for the pressure unit is based on a reference temperature of 4 °C (39.2 °F).
- 2) The conversion factor of the pressure unit refers to a reference temperature of 0 °C (32 °F).

Calibration range / Output	
Lower range value (LRV):	_____ [pressure unit]
Upper range value (URV):	_____ [pressure unit]

User interface
Display of the content of the main line (option depends on sensor and communication variant)
<input type="checkbox"/> Primary value [PV] (default)
<input type="checkbox"/> Primary value [%]
<input type="checkbox"/> Pressure
<input type="checkbox"/> Current [mA] (HART only)
<input type="checkbox"/> Temperature
<input type="checkbox"/> Error number
<input type="checkbox"/> Alternating display

Damping
Damping: _____ sec (Default 2 sec)

Smallest span (factory calibration) →  12



## Accessories

### HistoROM®/M-DAT

The HistoROM®/M-DAT is a memory module that can be attached to any electronic insert.

Ordering information:

Product Configurator, order code for "Additional options 1" or "Additional options 2", version "N" or as a separate accessory (part no.: 52027785).

### Welding flanges and welding neck

For details, refer to TI00426F/00/EN "Weld-in adapters, process adapters and flanges".

### Adapter Uni

The following adapters can be used to create a connection between the customer's process connection and the Deltapilot S with a universal adapter:

For dimensions and technical data, see Technical Information TI00426F.

Designation	Material	Order code	Order number with 3.1 inspection certificate
DIN 11851 DN 40	AISI 316L (1.4435)	71114172	71114178
DIN 11851 DN 50		71114173	71114205
DRD DN50		71114174	71114206
Clamp 2"		71114176	71114207
Varivent		71114177	71114208

### Additional mechanical accessories

Cable shortening kits, test adapters, mounting brackets, flushing rings and protective roofs.

For details see SD01553P/00/EN "Mechanical accessories for pressure measuring devices".

## Supplementary documentation

<b>Field of Activities</b>	Pressure measurement, powerful instruments for process pressure, differential pressure, level and flow: FA00004P/00/EN
<b>Technical Information</b>	<ul style="list-style-type: none"> <li>■ Cerabar S: TI00383P/00/EN</li> <li>■ Deltabar S: TI00382P/00/EN</li> <li>■ EMC test procedures: TI00241F/00/EN</li> <li>■ Weld-in adapters, process adapters and flanges: TI00426F/00/EN</li> </ul>
<b>Special Documentation</b>	Mechanical accessories for pressure measuring devices: SD01553P/00/EN
<b>Operating Instructions</b>	<p>4 to 20 mA HART:</p> <ul style="list-style-type: none"> <li>■ Deltapilot S: BA00332P/00/EN</li> <li>■ Description of device functions Cerabar S/Deltabar S/Deltapilot S: BA00274P/00/EN</li> </ul> <p>PROFIBUS PA:</p> <ul style="list-style-type: none"> <li>■ Deltapilot S: BA00356P/00/EN</li> <li>■ Description of device functions Cerabar S/Deltabar S/Deltapilot S: BA00296P/00/EN</li> </ul> <p>FOUNDATION Fieldbus:</p> <ul style="list-style-type: none"> <li>■ Deltapilot S: BA00372P/00/EN</li> <li>■ Description of device functions Cerabar S/Deltabar S/Deltapilot S: BA00303P/00/EN</li> </ul>
<b>Brief Operating Instructions</b>	<ul style="list-style-type: none"> <li>■ 4 to 20 mA HART, Deltapilot S: KA01020P/00/EN</li> <li>■ PROFIBUS PA, Deltapilot S: KA01023P/00/EN</li> <li>■ FOUNDATION Fieldbus, Deltapilot S: KA01026P/00/EN</li> </ul>
<b>Functional safety manual (SIL)</b>	Deltapilot S (4 to 20 mA): SD00213P/00/EN
<b>Overfill protection</b>	WHG: ZE00266P/00/EN
<b>Safety Instructions (XA)</b>	Depending on the approval, the following Safety Instructions (XA) are supplied with the device. They are an integral part of the Operating Instructions.

Directive	Electronic insert	Documentation	Option <sup>1)</sup>
ATEX II 1/2 G Ex ia IIC T6	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00283P	1
ATEX II 1/2 G Ex ia IIC T6, WHG (German Water Resources Act)	4 to 20 mA HART	XA00283P and ZE00266P	6
ATEX II 1/2 D	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00284P	2
ATEX II 1/3 D	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00285P	4
ATEX II 1 GD Ex ia IIC T6	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00287P	8
ATEX II 1/2 GD Ex ia IIC T6	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00286P	3
ATEX II 3 G Ex nA II T6	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00288P	7
ATEX II Ex ia + FM IS + CSA IS ATEX II 1/2G Ex ia IIC T6+ FM/CSA IS CL.I,II,III Div.1 Gr.A-G	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00252P	E

1) Product Configurator, order code for "Approval"

Directive	Electronic insert	Documentation	Option <sup>1)</sup>
IECEX Zone 0/1 Ex ia IIC T6	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XB00010P	I

1) Product Configurator, order code for "Approval"

Directive	Electronic insert	Documentation	Option <sup>1)</sup>
NEPSI Ex ia IIC T4/T6	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00435P	H

1) Product Configurator, order code for "Approval"

Directive	Electronic insert	Option <sup>1)</sup>
TIIS Ex ia IIC T4	4 to 20 mA HART	K

1) Product Configurator, order code for "Approval"

Directive	Electronic insert	Documentation	Option <sup>1)</sup>
INMETRO Ex ia IIC T6 Ga/Gb	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA01320P/00	J
INMETRO Ex ta IIIC Da/Db	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA01319P/00	Z

1) Product Configurator, order code for "Approval"

**Installation/Control Drawings**

Directive	Electronics	Documentation	Option <sup>1)</sup>
FM DIP Cl.II,III Div.1 Gr.E-G, Zone 21,22	-	<ul style="list-style-type: none"> <li>■ XA01059P</li> <li>■ XA01060P</li> </ul>	Q
FM NI Cl.I Div.2 Gr.A-D, Zone 2	-	XA01065P	R
FM IS Class I, II, III, Division 1, Groups A – G; NI, Class I Division 2, Groups A – D; AEx ia	<ul style="list-style-type: none"> <li>■ 4 to 20 mA HART</li> <li>■ PROFIBUS PA, FOUNDATION Fieldbus</li> </ul>	<ul style="list-style-type: none"> <li>■ XA01061P</li> <li>■ XA01062P</li> </ul>	S
CSA IS Class I, II, III, Division 1, Groups A – G; Class I Division 2, Groups A – G;	<ul style="list-style-type: none"> <li>■ 4 to 20 mA HART</li> <li>■ PROFIBUS PA, FOUNDATION Fieldbus</li> </ul>	<ul style="list-style-type: none"> <li>■ ZD00215P</li> <li>■ ZD00217P</li> </ul>	U
CSA C/US Cl.II, III Div.1 Gr.E-G	-	-	W
CSA C/US General Purpose	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	-	X

1) Product Configurator, order code for "Approval"



[www.addresses.endress.com](http://www.addresses.endress.com)

---